

Three-Phase State Estimation Using Hybrid Particle Swarm Optimization

Sara Nanchian, *Student Member, IEEE*, Ankur Majumdar, *Student Member, IEEE*,
and Bikash C. Pal, *Fellow, IEEE*

Abstract—This paper proposes a method for three-phase state estimation (SE) in power distribution network including on-load tap changers (OLTC) for voltage control. The OLTC tap positions are essentially discrete variables from the SE point of view. Estimation of these variables in SE presents a formidable challenge. The proposed methodology combines discrete and continuous state variables (voltage magnitudes, angles, and tap positions). A hybrid particle swarm optimization (HPSO) is applied to obtain the solution. The method is tested on standard IEEE 13- and 123-bus unbalanced test system models. The proposed algorithm accurately estimates the network bus voltage magnitudes and angles, and discrete tap values. The HPSO-based tap estimation provides a more accurate estimation of losses in the network, which helps in fair allocation of cost of losses in arriving at overall cost of electricity.

Index Terms—Hybrid particle swarm optimization (HPSO), tap estimation, three-phase state estimation (SE).

I. INTRODUCTION

THE STATE estimation (SE) is described as a process of finding network voltage magnitudes and angles so that all the other network quantities such as transformer, feeder loadings, etc. can be obtained from them. SE is a standard computational task in supervisory control and data acquisition (SCADA) for transmission system. At transmission level generalized framework [1] is well adopted for SE with emphasis on bad data analysis including handling switch status error. There is always an assumption of balanced system at transmission level so single-phase positive sequence network data are adequate. The distribution network is hardly balanced and symmetric so three-phase SE is necessary. Until recently it was not much important to have mandatory SE at distribution system. But with growing controllable devices and components, it is now important to have state estimator for efficient operation of the distribution network.

Manuscript received April 14, 2015; accepted April 26, 2015. Date of publication May 19, 2015; date of current version April 19, 2017. This work was supported in part by the Engineering and Physical Sciences Research Council (EPSRC) under Grant EP/F037686/1; in part by the Power Network Research Academy by EPSRC, U.K.; and in part by the Scottish and Southern Energy Networks, U.K. Paper no. TSG-00420-2015.

The authors are with the Department of Electrical and Electronics Engineering, Imperial College London, London SW7 2AZ, U.K. (e-mail: s.nanchian11@imperial.ac.uk; ankur.majumdar@imperial.ac.uk; b.pal@imperial.ac.uk).

Color versions of one or more of the figures in this paper are available online at <http://ieeexplore.ieee.org>.

Digital Object Identifier 10.1109/TSG.2015.2428172

There have been growing literatures in distribution system SE (DSSE). Chen *et al.* [2] have provided a thorough model of distribution transformer including core loss to obtain more accurate state estimates. Standard weighted least square (WLS) is suggested. The quality and adequacy of measurements being less than required—several papers focused on accurately estimating the loads through additional measurement placements. References [3]–[5] have proposed the concept of minimum additional measurements for improving accuracy of the SE in WLS framework. Because of the radial nature of the distribution network it was found computationally much easier to formulate feeder current as state variables [6], [7]. The results are very convincing and with slight modification in the form of inclusion of constraints in the optimization objective, small meshed network can also be solved. Small meshed network arises from closing normally open point to extend the feed. Wang and Schulz [8] later extended the branch current-based estimation to obtain set of locations where placement of meters provide maximum impact in terms of accuracy. References [9]–[12] have demonstrated the impact of various degrees of unbalanced in the network loads and parameters and topological uncertainties on the accuracies of SE. Zero injection is taken as constraints in the nodes having no measurement. Meliopoulos *et al.* [13] and Zhong and Abur [14] have demonstrated further the impact of inaccurate parameters, untransposed lines, ignored transformer vector groups etc. not only on the accuracy of the estimated quantities but on the bad data rejection capability as well. This led to the requirement of synchronized phasor measurements at the distribution level. Recently, Houghton and Heydt [15] proposed a linear state estimator for full three-phase unbalanced distribution system. It assumes that synchronized phasor measurement unit (PMU)-based measurement and other smart demand measurements are available. It is indicated smart meters may record and transmit active and reactive power, energy consumption over time intervals, e.g., 5, 15, and 60 min, so real time SE is not possible. Thukaram *et al.* [16] used graph theory approach to place measurement to guarantee observability and then solve the node current injection equations to obtain node voltage and angle which appears to work as robust approach to obtain the estimates. The radial nature of the distribution network is exploited by the backward forward sweep method proposed in [17] which is somewhat along the lines of load estimation as performed in radial distribution system power flow computation. It refines the pseudo measurement

by power summation at node. Reference [18] provides faster algorithm for estimating loads. The approach is to reduce the complexity of the network into several load estimation zones connected through physical measurements. None of the above references considered primary distribution transformer on load tap changing position as estimated variable. This exclusion of transformer tap position as estimated variable from the above references encouraged us to develop a three-phase SE algorithm including the tap as discrete variable and obtain the exact tap position which is not possible by conventional WLS method.

Distribution network has also other problem of rapid voltage fluctuation because of the indeed from DG. The output from DG being not predictable (solar and wind) the voltage variation in the network is very severe. So the voltage control is as important as feeder flow control. On load tap changing transformer in the primary substation is also subjected to rapid control actions. It is very important to include tap position as an estimated variable so that network control can be performed more effectively. There have not been much literature in tap observability detection. Pires *et al.* [19] proposed a robust algorithm based on Givens rotation of the gain matrix to obtain the state and tap position under erroneous zero injection. The method is demonstrated to work well in Brazilian system models of varying complexity. Shiroie and Hosseini [20] used node voltages, angles and tap position as state variables under the assumption that the taps are continuous. However, in practice OLTC has discrete tap positions so inaccurate estimate produces inaccurate computed values of other network quantities such as feeder flows, losses, etc. So, the incorporation of the discrete tap variables in SE is required for effective network control.

Commonly, SE algorithm is developed based on the assumption of balanced network model which assumes that line parameters and loads are balanced. Based on this assumption the analysis is applied on the single-phase model, simply using the positive sequence network for estimation of the system states. However, in distribution networks the presence of single and two-phase laterals, untransposed three-phase circuits and unbalanced loads affect the accuracy of the estimated states when assumption of balanced system is applied. This results in unexpected system performance or undesirable operating situations. So, an appropriate three-phase estimator is required to accurately obtain the states with taps as discrete variables [7], [21]. The motivation of this paper came from the need of a comprehensive three-phase state estimator including tap as discrete variable to obtain most accurate network nodal voltages and angles under unbalanced situation.

SE is commonly formulated as a WLS problem [22]. However, transformer tap positions make the problem a mixed integer nonlinear one. So, the solution of the problem through normal equation framework is not possible as the objective function is not differentiable [23].

Teixeira *et al.* [24] and Korres *et al.* [25] have assumed continuous taps instead of discrete and have incorporated rounding technique or sensitivity method to address the complexity of discrete values. However, this assumption reduces the accuracy of the SE and the solution does not represent

the actual network taps positions. Therefore, the estimation of transformer tap positions has to be obtained from the solution of the mixed integer nonlinear optimization problem containing continuous and discrete values [26], [27].

There has been growing interest in the application of heuristic algorithms such as neural networks, genetic algorithms (GAs), honey bee mating optimization, and particle swarm optimization (PSO) in recent years. To overcome the computational difficulty of such complex optimization problem, these algorithms have been successfully applied to wide range of optimization problem where they can handle mixed integer variables of the objective functions as they do not need the function to be continuous and differentiable [28].

PSO appears to be a very effective technique compared to GA and other evolutionary algorithms as it is simple in concept and implementation. It has limited number of parameters in comparison to other heuristic optimization methods. It can be easily applied to diverse issues where it can produce satisfactory solutions and stable convergence characteristics [29]. However, PSO has weak form of selection that increases the amount of time to get to the effective area in the solution space.

A hybrid form of PSO (HPSO) is used to overcome this situation [30] combining the feature from PSO and GA. HPSO has been applied in balanced SE problem [31]. HPSO uses a selection method which is based on the evolution from generation to generation. Reference [31] considered a balanced three-phase distribution network model without considering unbalanced nature of the system and discrete tap as state variables.

Our research proposes a full three-phase state estimator including unbalanced load, network model and the discrete taps as additional estimated variables based on HPSO optimization technique in order to estimate the discrete value of the transformer taps. The contribution of our research lies in handling the complexity of the unbalanced system and correctly computing the discrete values of the tap. The performance of the proposed method has been tested on IEEE 13- and 123-bus test system models and the results are presented.

Like all the methods based on heuristic search, the HPSO method takes longer time (tens of minutes) to converge in a reasonably sized network model. This apparently weakens the case for HPSO for SE in real time. It is important to note that SE in distribution SCADA is not done in real time. Since the life expectancy of the tap changing mechanism is influenced by the number of operations of the taps, it is also not allowed to have frequent tap operation when rapid changes and loads and generation take place. HPSO can be applied for network computation used for operational planning purposes such as hour ahead contingency analysis and reactive power control scheduling, loss estimation for dynamic pricing purpose. The HPSO-based solution in this way is still attractive to operate the network with higher efficiency even though the calculation is not done in real time. This paper demonstrates the value of this concept through comprehensive modeling, computation and analysis in this context. We have also made several modifications

of traditional PSO and HPSO techniques to obtain solutions faster.

This paper is organized as follows. Section II provides an overview of SE in distribution system. In Section III, the PSO solution method is described. Section IV provides an overview of HPSO. Section V presents the HPSO approach in the context of three-phase unbalanced SE for distribution network model. Section VI demonstrates the results and discussions of the SE for IEEE 13- and 123-bus model networks. Section VII concludes this paper.

II. DISTRIBUTION SYSTEM STATE ESTIMATION

The solution to DSSE problem is formulated as a minimization of the following objective function subject to satisfying several equality and inequality constraints. The goal is to obtain the bus voltage magnitudes, angles and tap positions that minimizes weighted square of the difference between the measured quantity and the estimated quantity which are functions of estimated states. It is expressed as

$$\min J(x) = \sum_{i=1}^m w_{ii} r_i^2 \quad (1)$$

$$\text{subject to: } z_i = h_i(x) + r_i \quad (2a)$$

$$c(x) = 0 \quad (2b)$$

$$g_{\min} \leq g(x) \leq g_{\max} \quad (2c)$$

where

- x state variables such as voltage magnitudes, angles, and tap positions;
- m number of measurements;
- w_{ii} weighting factor of measurement variable i , $z = [z_1^a \ z_1^b \ z_1^c \ \dots \ z_m^a \ z_m^b \ z_m^c]$;
- z_i measured value of i th measurement;
- h_i i th measurement as a function of state x ;
- r_i i th measurement error.

In three-phase system $x = [V_i^k \ \delta_i^k \ t_i^k]$, where $V_i^k = [V_i^a \ V_i^b \ V_i^c]^T$ is the vector of three-phase voltage magnitude at bus i , $\delta_i^k = [\delta_i^a \ \delta_i^b \ \delta_i^c]^T$ denotes the phase angles of bus i except the reference bus and $t_i^k = [t_i^a \ t_i^b \ t_i^c]^T$ is the transformer's tap vector if present at i th bus.

In three-phase model, the power injected at bus i for phase k can be written as

$$P_i^k = V_i^k \sum_{l=1}^3 \sum_{j=1}^n V_j^l \left[G_{ij}^{k,l} \cos(\delta_i^k - \delta_j^l) + B_{ij}^{k,l} \sin(\delta_i^k - \delta_j^l) \right] \quad (3)$$

$$Q_i^k = V_i^k \sum_{l=1}^3 \sum_{j=1}^n V_j^l \left[G_{ij}^{k,l} \sin(\delta_i^k - \delta_j^l) - B_{ij}^{k,l} \cos(\delta_i^k - \delta_j^l) \right] \quad (4)$$

where $G + jB$ is the system admittance matrix, n is number of buses and l is the number of phases that can be single-, two-, or three-phase. The power flow from buses i to j for phase k

can be written as follows:

$$P_{ij}^k = V_i^k \sum_{l=1}^3 V_j^l \left[G_{ij}^{k,l} \cos(\delta_i^k - \delta_j^l) + B_{ij}^{k,l} \sin(\delta_i^k - \delta_j^l) \right] - V_i^k \sum_{l=1}^3 V_j^l \left[G_{ij}^{k,l} \cos(\delta_i^k - \delta_j^l) + B_{ij}^{k,l} \sin(\delta_i^k - \delta_j^l) \right] \quad (5)$$

$$Q_{ij}^k = -V_i^k \sum_{l=1}^3 V_j^l \left[G_{ij}^{k,l} \sin(\delta_i^k - \delta_j^l) - B_{ij}^{k,l} \cos(\delta_i^k - \delta_j^l) \right] - V_i^k \sum_{l=1}^3 V_j^l \left[G_{ij}^{k,l} \sin(\delta_i^k - \delta_j^l) - B_{ij}^{k,l} \cos(\delta_i^k - \delta_j^l) \right] \quad (6)$$

where

- P_i^k, Q_i^k active and reactive power injection of phase k in bus i ;
- P_{ij}^k, Q_{ij}^k active and reactive power flow of phase k from buses i to j ;
- V_i^l voltage magnitude of phase l at bus i ;
- δ_i^l angle of phase l in bus i .

A. Equality Constraints $c(x)$

The equality constraints are the set of equation corresponding to virtual measurements

$$0 = P_{Gi}^k - P_{Di}^k - \sum_{l=1}^3 \sum_{j=1}^n V_i^k V_j^l \left[G_{ij}^{k,l} \cos(\delta_i^k - \delta_j^l) + B_{ij}^{k,l} \sin(\delta_i^k - \delta_j^l) \right] \quad (7)$$

$$0 = Q_{Gi}^k - Q_{Di}^k - \sum_{l=1}^3 \sum_{j=1}^n V_i^k V_j^l \left[G_{ij}^{k,l} \sin(\delta_i^k - \delta_j^l) - B_{ij}^{k,l} \cos(\delta_i^k - \delta_j^l) \right] \quad (8)$$

where P_{Gi}^k and Q_{Gi}^k are the real and reactive power injected at bus i , respectively, the load demand at the same bus is represented by P_{Di}^k and Q_{Di}^k [32]. Indices n is number of buses and l is the number of phases which can be single-, two-, or three-phase.

B. Inequality Constraints

These are the set of constraints of continuous and discrete variables that represent the system operational and security limits, such as setting upper and lower limits for control variables. These are as follows.

- 1) *Bus Voltage*: Voltage magnitudes at each bus in the network

$$V_{\min,i}^k \leq V_i^k \leq V_{\max,i}^k$$

- 2) *Bus Angle*: The bus angle at each bus in the network

$$-\delta_{\min,i}^k \leq \delta_i^k \leq \delta_{\max,i}^k$$

- 3) *Transformer Taps*: Transformer taps settings

$$t_{\min,i}^k \leq t_i^k \leq t_{\max,i}^k$$

III. PARTICLE SWARM OPTIMIZATION

The PSO is a population-based optimization method first proposed by Kennedy and Eberhart [33], which is used to search the solution space of a given problem to find the candidate solution which can maximize or minimize a particular objective function. Some of the attractive features of the PSO include the ease of application and the fact that no gradient information is required which allows the PSO to be used on functions where the gradient is either unavailable or computationally expensive to obtain. It generates high quality solutions and has stable convergence characteristic than other stochastic methods; so can be used to solve a wide array of optimization problems. It uses a number of particles that constitute a swarm. Each particle traverses the search space looking for the global minimum (or maximum). During flight, each particle adjusts its position according to its own experience and the experience of neighboring particles, making use of the best position encountered by itself (pbest) and its neighbors (gbest). Let X and V represent a particle position and its corresponding velocity in a search space, respectively. The best previous position of a particle is recorded and represented as pbest. The index of the best particle amongst all the particles in the group is represented as gbest. The modified velocity and position of each particle are calculated as follows [34]:

$$V_{ij} = WV_{ij}^0 + C_1R_1 \times (X_{\text{pbest}} - X_{ij}^0) + C_2R_2 \times (X_{\text{gbest}} - X_{ij}^0) \quad (9)$$

$$X_{ij} = X_{ij}^0 + V_{ij} \quad (10)$$

where

- i i th particle;
- j dimension of the velocity associated with particle i ;
- V_{ij}, X_{ij} velocity and position of the particle at iteration j ;
- W weighting function;
- C_1, C_2 weighting factors;
- R_1, R_2 random numbers between 0 and 1.

In (9), X_{pbest} is the pbest of particle and X_{gbest} is the gbest of the group.

A. Selection of Parameters for PSO and Simulation Condition

The selection of key parameters to set up PSO such as W , C_1 , C_2 , and V_{max} is an important task as they govern the rate of convergence.

1) *Weighting Function*: W is a weighting factor which is related to the velocity of the particle during the previous iteration. It controls the amount of the previous velocity that particle takes in the next iteration. This value is equal to 1.0 for the original PSO. The concept of velocity will be lost if this value is set to zero. Shi and Eberhart [35] investigated the effect of W in the range (0.0, 1.4). The faster convergence is obtained by setting this value between (0.8, 1.2). However, setting of inertia weight that decreased from 0.9 to 0.4 generated satisfactory result [34].

The weighting function is obtained as

$$W = W_{\text{ini}} - \frac{(W_{\text{ini}} - W_{\text{fin}}) \times \text{iter}}{\text{iter}_{\text{max}}} \quad (11)$$

where W_{ini} and W_{fin} are the initial and final weight, respectively, iter_{max} is the maximum iteration number, and iter is the current iteration number.

2) *Acceleration Coefficients (C_1 and C_2)*: C_1 and C_2 affect the maximum step size of a particle in a single iteration. C_1 regulates the maximum step size of a particle in the direction of the pbest while C_2 regulates the maximum step size in the direction of the gbest [34] as shown in (9).

The particle velocity is limited by V_{max} to minimize the possibility of the particle escaping the search space. If the search space is defined by the bounds $[X_{\text{min}}, X_{\text{max}}]$, the value of V_{max} is typically set to

$$V_{\text{max}} = K \times (X_{\text{max}} - X_{\text{min}}) \quad (12)$$

where

$$0.1 \leq K \leq 1.0.$$

Initially, PSO has been performed several times with different values of the key parameters of W , C_1 , C_2 , and V_{max} to achieve the satisfactory results.

B. Improving the Speed of Convergence

We have made appropriate modification to update the position of the particle by changing the direction when reaching the search space boundary in order to improve the speed of convergence. The direction of the particle should be modified in such a way that it keeps the particle inside its range when the velocity takes the particle out of its boundary $[X_{\text{min}}, X_{\text{max}}]$. So the new position of the particle will be updated-based on the following equation instead of (10):

$$X_{ij} = X_{ij}^0 - V_{ij} \quad (13)$$

the optimal solution be close to the boundary the α factor helps to reach the solution faster

$$X_{ij} = X_{ij}^0 - \alpha V_{ij} \quad (14)$$

where α is an optimally chosen number between 0 and 1. We have discussed about a suitable value of alpha later in the discussion section.

C. General Algorithm for PSO

The general steps of PSO algorithm can be described as follows.

- 1) Generate initial population of particles with random velocities and positions. In this paper, these particles are bus voltage magnitudes and angles and transformer tap positions.
- 2) These initial particles must be feasible candidate solutions that satisfy the practical operation constraints. Set upper and lower limits for these particles (v, δ, t).
- 3) For each particle of the population, calculate the error based on (2a).
- 4) Obtain value of each particle in the population using the evaluation function (fitness function) and the penalty function. The value of fitness function is obtained as follows:

$$FF(x) = \frac{1}{1 + J(x) + \text{Penalty}(x)} \quad (15)$$

where $J(x)$ comes from (1) and $\text{Penalty}(x)$ as follows:

$$\text{Penalty}(x) = \rho \sum_i^N (x_i - x_0)^2 \quad (16)$$

N number of penalized control variables;

ρ scalar quadratic penalty weight;

x_0 control variable current value (p.u.);

x_i control variable penalty offset (p.u.).

- 5) Compare each particles value with its pbest. The best value among the pbest is denoted as gbest.
- 6) Update the time counter $t = t + 1$.
- 7) Update the inertia weight W given by (11).
- 8) Modify the velocity V of each particle according to (9).
- 9) Modify the position of each particle according to (10) and (14). If a particle violates its position limits in any dimension, set its position at the proper limit according to (14).
- 10) Each particle is evaluated according to its updated position. If the value of each particle is better than the previous pbest, the current value is set to be pbest. If the best pbest is better than gbest, this value is set to be gbest.
- 11) If the maximum of a variation of the state variable Δx is smaller than 0.001 and the iteration has reached maximum number of iteration specified go to step #12. Otherwise, go to step #6 until the end criteria are satisfied.
- 12) The particle that generates the latest gbest is the optimal value.

IV. HYBRID PARTICLE SWARM OPTIMIZATION

The PSO algorithm has a weak selection process which very much depends on pbest and gbest, therefore, the searching area is limited by pbest and gbest. This leads to increase in the amount of time that it takes to get to the effective area in the solution space. The HPSO method has been introduced based on tournament selection method of GA, in order to improve the weakness of PSO method in this area. The introduction of the tournament selection mechanism in PSO algorithm, the effect of pbest and gbest is gradually eliminated by the selection which can result in the wider search area. The purpose of the selection in evolutionary algorithm is to influence the execution of the algorithm on a specific region of search space; usually one that delivered promising solutions in the recent past. Particle positions with low values are replaced by those with high values using the tournament selection method [30]. Therefore, the number of highly evaluated particles is increased while the number of lowly evaluated particles is reduced at each iteration. It should be mentioned that although, the particle position is substituted by another particle position, the information related to each particle is reserved. Therefore, the intensive search in a current effective area and dependence on the past high evaluation position are realized [30].

V. DISTRIBUTION SYSTEM STATE ESTIMATION BY HPSO

This section presents the application of the HPSO algorithm for solving the DSSE problem. The set of tasks involve.

A. Network Configuration and Network Data

The presence of unsymmetrical-network components and unbalanced-load on unbalanced distribution system makes it essential to consider the exact model of the system components (three-phase model). It includes the information about line resistance, reactance, tap setting connectivity information, etc.

Therefore, the following provides information regarding three-phase model of various components of the network such as line, transformers and switches [36].

1) *Line Model*: The distribution overhead lines and underground cables are three-, two-, or single-phase and are most often untransposed serving unbalanced loads. In addition, since the voltage drops due to the mutual coupling of the lines is playing important part in the analysis of the distribution network, it is important to compute the impedance of the overhead and underground line segment as accurate as possible. Therefore, it is necessary to retain the self and mutual impedance terms of the conductors and take into account the ground return path for the unbalanced currents [37].

A modified Carson's equation has been applied to model the overhead lines and underground cables

$$Z_{ii} = r_i + 0.095 + j0.121 \times \left(Ln \frac{1}{\text{GMR}_i} + 7.934 \right) \Omega / \text{mile} \quad (17)$$

$$Z_{ij} = 0.095 + j0.121 \times \left(Ln \frac{1}{D_{ij}} + 7.934 \right) \Omega / \text{mile} \quad (18)$$

where

- Z_{ii} self-impedance of conductor i in Ω/mile ;
- Z_{ij} mutual impedance between conductors i and j in Ω/mile ;
- r_i resistance of conductor i in Ω/mile ;
- GMR_i geometric mean radius of conductor i in feet;
- D_{ij} distance between conductors i and j in feet.

While using the modified Carson's equations there is no need to make any assumptions, such as transposition of the lines. By assuming an untransposed line and including the actual phasing of the line and correct spacing between conductors, the most accurate values of the phase impedances, self and mutual, are determined.

While applying modified Carson's equations (17) and (18) to a three-phase overhead or underground circuit which consists of n phases and neutral conductors the resulting impedance matrix will be $n \times n$. For most applications, it is necessary to have the 3×3 phase impedance matrix. Therefore, the following Kron's reduction is applied in order to breakdown the impedance matrix into the 3×3 phase frame matrix. In this approach, all the lines will be modeled by 3×3 phase impedance matrix and for two- and single-phase lines the missing phases are modeled by setting the impedance element to zero [37]

$$Z_{ij} = Z_{ij} - \frac{Z_{in} \times Z_{nj}}{Z_{nn}}. \quad (19)$$

2) *Transformer Model*: The three-phase transformer banks are commonly used in the distribution network and provide the final voltage transformation to the customers load. The conventional transformer models based on a balanced

three-phase assumption can no longer be used when system is unbalanced. Three-phase transformers are modeled by an admittance matrix which depends on the connection type. The admittance matrix of a transformer is sub-divided into sub-matrices for both self and mutual admittances between the primary and secondary. In the analysis of the distribution feeder, it is required to model the various three-phase transformer connections correctly. The comprehensive calculations of three-phase transformers and their various connections can be found in [37].

3) *Switch Model*: Switches are modeled as branches with zero impedance when the switch is closed or as branches with zero admittance when it is open. The operational constraints imposed by the open or closed status of the switching branches will be as follows.

- 1) When the switch between buses i and j is closed for branch $i-j$, the voltages and angles for buses i and j for all the three phases are equal

$$\begin{aligned} V_i - V_j &= 0 \\ \delta_i - \delta_j &= 0. \end{aligned}$$

- 2) When the switch is open between buses i and j , the active and reactive power flow to the switch will be zero

$$\begin{aligned} P_{ij} &= 0 \\ Q_{ij} &= 0. \end{aligned}$$

These have been included as equality constraints in the SE formulation and a weighted quadratic penalty function defined in (16) is applied to solve the above equality constraint problem in which a penalty factor is added to the objective function moment any constraint violation occurs.

4) *Load Model*: The loads on distribution network are generally unbalanced and can be connected in a grounded wye configuration or an ungrounded delta configuration. It is also possible to have three-, two-, or single-phase loads with varying degree of unbalance. The loads are commonly indicated by complex power consumed per phase and supposed to be line-to-neutral for wye load and line-to-line for delta load [37].

In this paper, loads are modeled as constant impedance, constant current and constant complex power or any combination of the three. Typically, the load values are given as nominal power delivered to the load and must be converted into the appropriate constant model parameters. The general form of ZIP model is as follows [38]:

$$P_L = P_n \left[c_1^P + c_2^P \left(\frac{V}{V_n} \right) + c_3^P \left(\frac{V}{V_n} \right)^2 \right] \quad (20)$$

$$Q_L = Q_n \left[c_1^Q + c_2^Q \left(\frac{V}{V_n} \right) + c_3^Q \left(\frac{V}{V_n} \right)^2 \right]. \quad (21)$$

The two- and single-phase loads are modeled by setting the values of the complex power to zero for the nonexistent phases for both wye and delta connected loads [37].

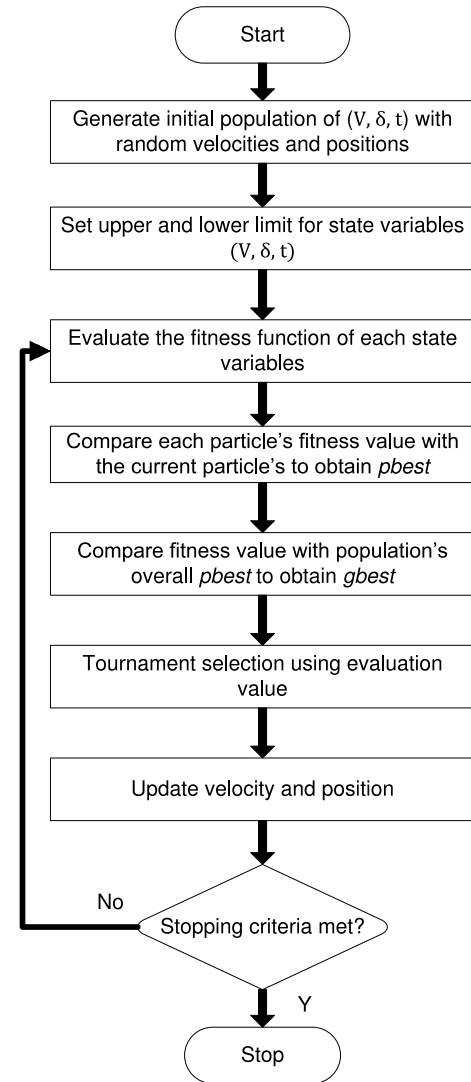


Fig. 1. Setting up of HPSO.

B. Power Flow Calculation

Three-phase power flow program suitable for distribution system has been set up with network information and load data to generate measurement data as an input to the state estimator. The normally distributed noise component has been added to these measurements to produce input for state estimator. Usually, 1%–3% error is associated with true measurements while the error for pseudo measurements (load data) is considered to vary between 20% and 50%.

C. State Estimation Based on HPSO Algorithm

The following steps have been followed to estimate the state by HPSO estimator.

- 1) Set up a set of HPSOs parameters such as number of particles N , weighting function W , acceleration coefficients C_1 and C_2 , and maximum number of iterations.
- 2) Generate an initial population of the state variables (V , δ , and t) with random velocities and positions in the solution space.
- 3) Set upper and lower limits for state variables (V , δ , and t).

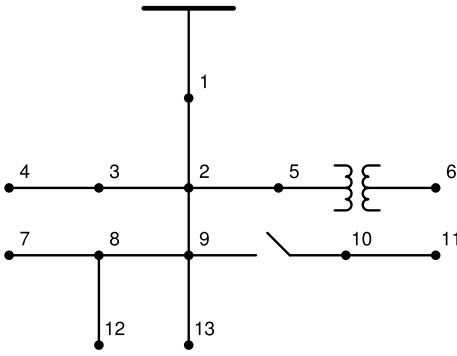


Fig. 2. IEEE 13-bus distribution system.

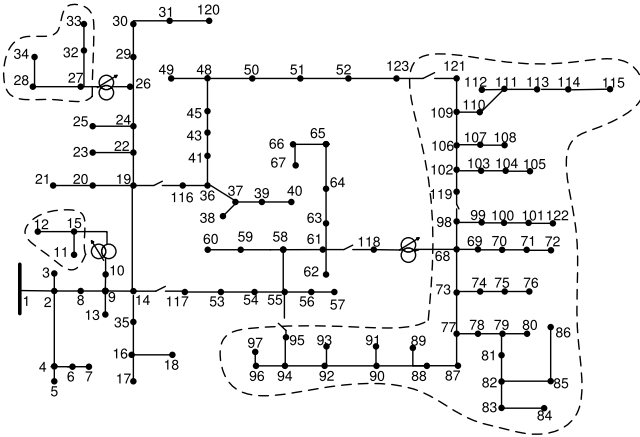


Fig. 3. IEEE 123-bus distribution system.

- 4) For each state variable, if the variable is within the set limits, go to the following step. Otherwise, that variable is infeasible.
- 5) The state has been calculated based on the minimization between measurements and calculated value based on HPSO algorithm.

Fig. 1 illustrates the DSSE using HPSO algorithm.

VI. RESULTS AND DISCUSSION

A. Case Studies

The proposed modified HPSO approach was implemented in MATLAB by Intel Xeon processor at 2.40 GHz with 12.0 GB of RAM and has been tested on IEEE 13- and 123-bus test systems to validate the proposed algorithms. The network parameters and load data are obtained from [39] and [40]. The topologies of the test systems are shown in Figs. 2 and 3. The systems consist of both overhead lines and underground cables. The overhead lines and underground cables have been modeled with modified Carson’s equations. There are both three- and single-phase loads. The three-phase loads are either star or delta connected. The loads in the system have been modeled in ZIP-model. A three-phase transformer is modeled as three individual single-phase transformers.

Measurements were generated using three-phase power flow program with addition of normally distributed noise component to generate noisy measurements. The error of true

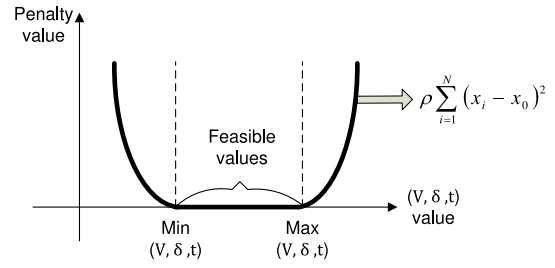


Fig. 4. Proposed penalty function.

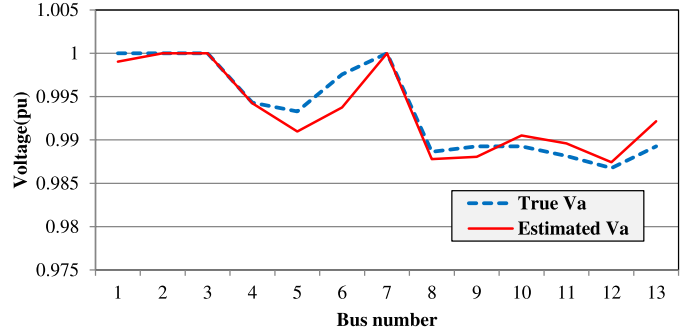


Fig. 5. True and estimated phase voltage a for IEEE 13 bus system.

measurement was assumed 3% while the error in pseudo-measurement (load data) was considered 20%.

Several trials are performed for appropriate parameter value selection. Appropriate combination of W_{ini} , W_{fin} , C_1 , C_2 have been applied. The following values have been chosen for HPSO estimator; $W_{ini} = 0.9$, $W_{fin} = 0.4$, $C_1 = C_2 = 2.05$. The values are very close to those recommended by Naka *et al.* [31] and van den Bergh [34]. In order to choose the best value for alpha, the algorithm was run for different values of alpha between 0 and 1 in step of 0.1 in order to obtain the value with the least convergence time. It is found that $\alpha = 0.2$ produces the best convergence speed for this example system. The number of particles and the number of iterations are 200 and 1000, respectively. The lower and upper limits of control variables corresponding to the coding on the HPSO is set in such a way that the inequality constraints of the control variables are satisfied as listed in (22a). The shape of the proposed penalty function is displayed in Fig. 4

$$0.95 \text{ p.u.} \leq V_i^a, V_i^b, V_i^c \leq 1.05 \text{ p.u.} \quad (22a)$$

$$-30^\circ \leq \delta_i^a, \delta_i^b, \delta_i^c \leq +30^\circ \quad (22b)$$

$$0.9 \leq t_i^a, t_i^b, t_i^c \leq 1.1. \quad (22c)$$

The tap ratio of transformer is specified in the range of 0.9–1.1 in steps of 0.00625.

The zero injections, voltages, and angles across the closed switch and voltage at the regulator bus have been taken as equality constraints in the SE formulation. A weighted quadratic penalty function is added to the objective function to take care of each of these equality constraints.

The switch between buses 9 and 10 is assumed to be closed for 13-bus test system. Figs. 5–7 show the real and estimated vector of voltages and Table I shows the real and estimated vector of angles at different phases of the IEEE 13-bus model

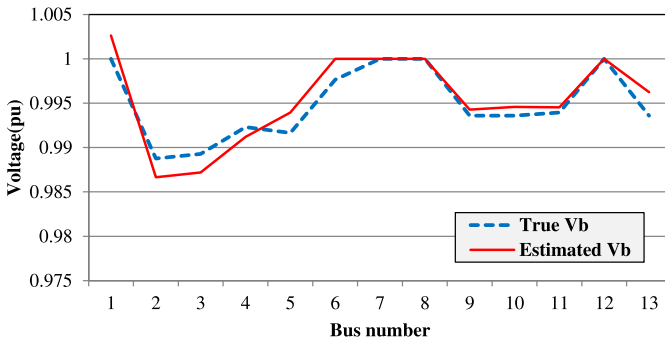


Fig. 6. True and estimated phase voltage b for IEEE 13 bus system.

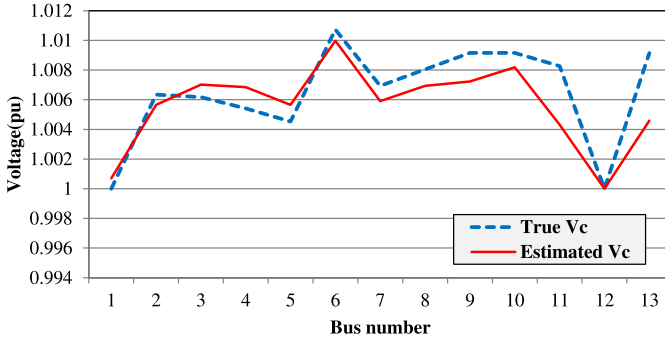


Fig. 7. True and estimated phase voltage c for IEEE 13 bus system.

TABLE I
TRUE AND ESTIMATED ANGLE

Bus number	True δ phase a	Estimated δ phase a	True δ phase b	Estimated δ phase b	True δ phase c	Estimated δ phase c
1	0	0	-120	-120	120	120
2	-	-	-119.57	-118.01	119.36	117.44
3	-	-	-119.62	-118.3	119.42	117.88
4	-0.2412	-0.2507	-119.68	-118.41	119.55	118.15
5	-0.264	-0.2541	-119.7	-118.21	119.55	117.86
6	-0.4974	-0.4869	-119.87	-118.64	119.39	117.11
7	-	-	-	-120	119.39	117.51
8	-0.6488	-0.6297	-	-120	119.41	117.62
9	-0.631	-0.6513	-119.25	-118.27	119.42	117.45
10	-0.631	-0.6494	-119.25	-117.8	119.42	117.65
11	-0.6725	-0.6845	-119.26	-117.78	119.45	117.49
12	-0.6242	-0.6332	-	-	-	-
13	-0.6317	-0.6193	-119.25	-118.19	119.42	117.26

distribution network. There are five switches in the 123-bus system. The switch between buses 121 and 123 is assumed to be open while other switches are assumed to be closed for this network. Figs. 8–10 show the real and estimated vector of voltages of the IEEE 123-bus model distribution network. In Figs. 5–10, the value of voltage has been taken as 1 where there is no phase available for the given bus on the graphs. Also, in Table I, the dashes show that there is no phase available for the given bus. The obtained results are found to be very satisfactory within the allowable error range. The main advantage of the HPSO-based method is in correct estimation of the transformer taps as it is shown in Table II for 13-bus test system and Table III for 123-bus system, which is the most important findings from this research reported here.

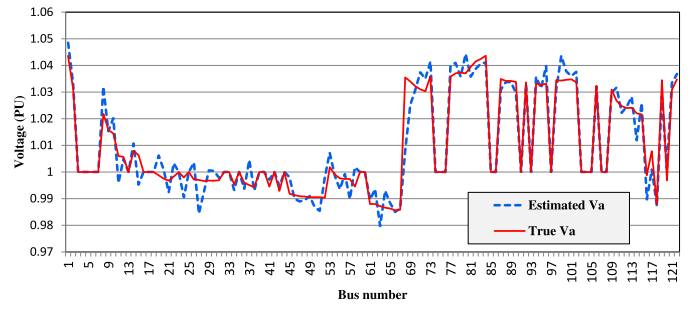


Fig. 8. True and estimated phase voltage a for IEEE 123 bus system.

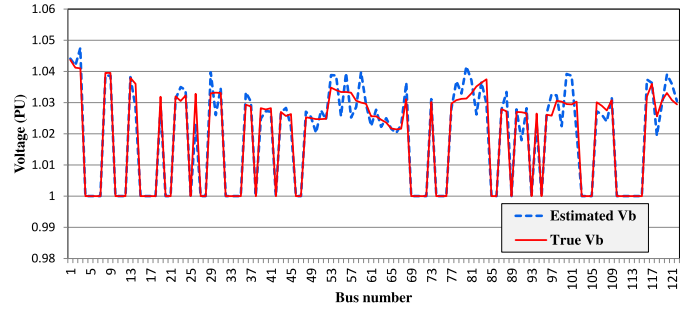


Fig. 9. True and estimated phase voltage b for IEEE 123 bus system.

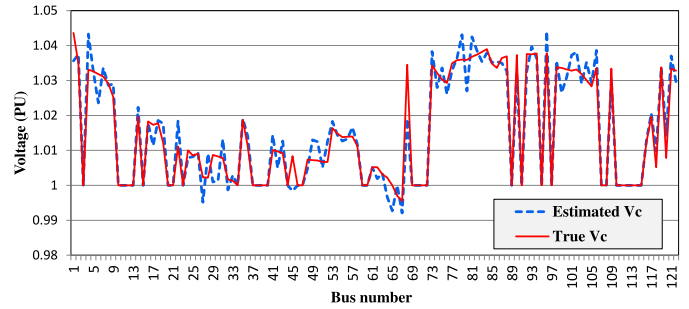


Fig. 10. True and estimated phase voltage c for IEEE 123 bus system.

TABLE II
TRUE AND ESTIMATED TAP POSITION FOR 13-BUS SYSTEM AT BUS 6

Phase	a	b	c
True Tap position	2	2	1
Estimated tap position HPSO	2	2	1

TABLE III
TRUE AND ESTIMATED TAP POSITION FOR 123-BUS SYSTEM

State variable	Real value	WLS	HPSO
T15-Phase a	-1	-1	-1
T27-Phase a	0	0	0
T27-Phase c	-1	-1	-1
T68-Phase a	8	7	8
T68-Phase b	1	1	1
T68-Phase c	5	4	5

B. Discussions

We have applied both PSO and HPSO to obtain tap position estimates. Both methods have been tested on IEEE 13- and 123-bus test systems. PSO takes on an average of 6–7 h to

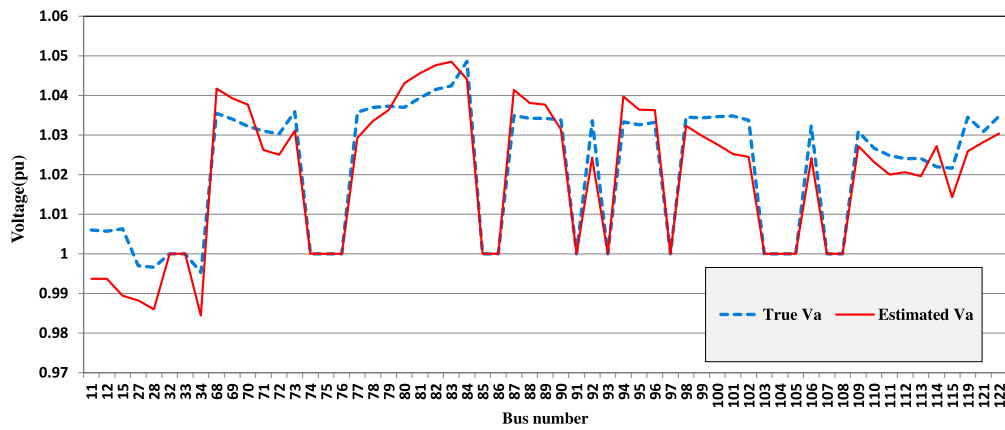


Fig. 11. True and estimated phase voltage a for reduced model of IEEE 123 bus system.

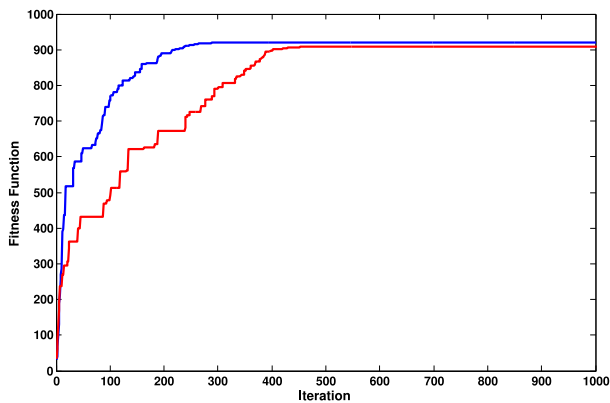


Fig. 12. Convergence characteristic of HPSO and PSO.

obtain the solution on 13-bus test system. We have modified the particle position update equation for improving the speed of convergence as given in (14). Therefore, the execution time reduced to 2–3 h. HPSO on the other hand takes 18–20 min to converge for 13-bus test system. The convergence characteristic of HPSO and improved PSO with correction are shown in Fig. 12 for 13-bus test system. As can be seen from convergence characteristic, HPSO method is much faster than PSO method.

In the ideal smart grid environment in principle the state estimator in distribution system should be running in real time. There are several practical limitations to realize this in practice. Even the data from modern smart meters are communicated to distribution SCADA every few hours. The most automated distribution network in the U.K. does not transmit data more than twice a day. The telecommunication infrastructure in most automated distribution network is such that it is not possible to transmit half hourly measured and stored smart meter data more than twice a day to the control center. Samarakoon *et al.* [41] have documented in details the standard and practice of data transmission from smart meters in various countries across the world. Given this situation, one obvious question arises: is there any possibility for real time SE in power distribution system in the forcible future? The frequency of tap operation is also another practical consideration. Considering the operating life of transformer, after 3000 operations, it requires maintenance and after 30 000 operations the

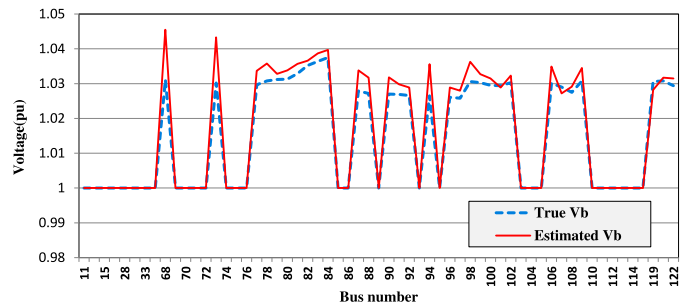


Fig. 13. True and estimated phase voltage b for reduced model of IEEE 123 bus system.

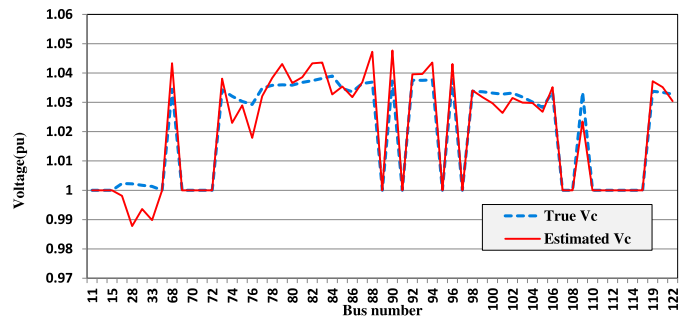


Fig. 14. True and estimated phase voltage c for reduced model of IEEE 123 bus system.

transformer tap changing mechanism should be replaced with a new one. In that case changing the tap position every few seconds will damagingly result in shortening the transformer operating life. So it is convincing that unlike transmission system the SE in distribution system will not run every 2–5 s.

Also, the HPSO method with correction for improving the speed has been applied to IEEE 123-bus test system model. It takes on an average of 4 h to obtain the solution. However, by identifying and considering only those buses where voltage and angles are affected significantly by changing the tap changer position the execution time has reduced to 90 min as a result of the reduction in the number of state variables. Those buses have been enclosed through a dashed line in Fig. 3 and the results are shown in Figs. 11, 13, and 14. One way to improve the speed of convergence of HPSO is to parallelize the algorithm. In the context of computation in power

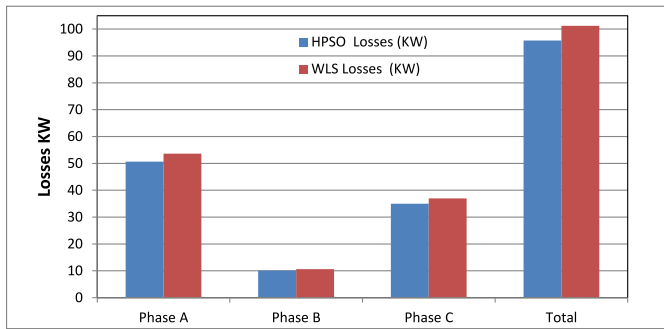


Fig. 15. KW losses for HPSO and WLS.

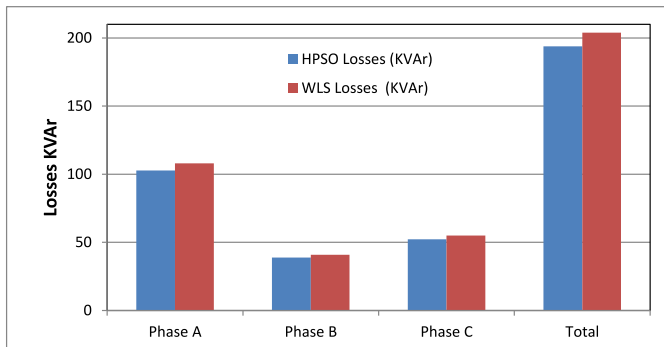


Fig. 16. KVAR losses for HPSO and WLS.

transmission, it has been explored to obtain improvement in speed of computation. Jeong *et al.* [42] have achieved 4.8 times faster than normal PSO for transmission system SE. Because of the similarity of the structure of the equations and between the inter-relationship between variables it is possible to achieve similar results based on the application of parallel PSO for the given network in this paper. This is not pursued further because of the lack of access to parallel computing cluster. The comparison of the results of tap estimation from WLS and HPSO reveals that estimation of the continuous values of tap changer may result in an inaccurate tap position since it is based on the rounding technique while HPSO provides the exact position of transformer taps by estimating the discrete values of transformer tap positions. So HPSO output provides more accurate voltage and angle estimates thus helps in obtaining better estimate of line and transformer loading and losses. This is very useful in dynamic price setting for efficient electricity market operation and also for optimum scheduling of voltage and var control (VVC) resources. The power losses in the lines for 123 node system have been computed and the results are shown in Figs. 15 and 16. It is clearly seen that HPSO-based technique provides more accurate loss figures. Given the customer has to bear the cost of the losses HPSO-based estimated voltage and angles and tap positions when used to calculate operational losses for pricing, they will result in more fairer value. This clearly justifies the novelty and benefit of this research contribution. One network operator (Scottish and Southern Energy) in the U.K. has already found this approach useful for network loss calculation in their 33/11 kV network. Compared to WLS-based approach

the computed network losses are noticeably different which is very useful outcome of this proposed methodology.

VII. CONCLUSION

The technique proposed in this paper has addressed the transformer taps estimation in the context of distribution SE. It has, for the first time, applied HPSO method to estimate transformer tap positions without any assumption and also in unbalanced three-phase distribution system. The simulation results on IEEE 13- and 123-bus standard system models showed that the HPSO method can generate reliable estimate for transformer taps with discrete variables in distribution network while minimizing the objective function. It is also demonstrated that it performs better when compared to PSO. This paper also contributes to novel strategies to expedite solution from PSO and HPSO. The solution from HPSO is accurate and is very useful for computation of various quantities accurately used in the operational planning time scale, i.e., VVC and pricing in short term market.

Moreover, operational losses from HPSO is much accurate in this case lower than WLS method. In that sense this method is better than WLS method as it provides higher accuracy. Such lower losses will help lowering the overall cost of electricity. In a distribution network where about 6% of electricity generated is lost, accurate estimation of that has huge technical and commercial benefits. The technique proposed in this paper definitely will help to realize those benefits.

No gross error is assumed in tap measurement, the tap position measured can be corrupted while being telemetered. A further work continues for bad tap error detection in a large practical power distribution network model. Also, our immediate future plan is to explore mixed integer nonlinear optimization solver for distribution SE problem.

REFERENCES

- [1] O. Alsac, N. Vempati, B. Stott, and A. Monticelli, "Generalized state estimation [power systems]," in *Proc. 20th Int. Conf. Power Ind. Comput. Appl.*, Columbus, OH, USA, May 1997, pp. 90–96.
- [2] T.-H. Chen, M.-S. Chen, T. Inoue, P. Kotas, and E. Chebli, "Three-phase cogenerator and transformer models for distribution system analysis," *IEEE Trans. Power Del.*, vol. 6, no. 4, pp. 1671–1681, Oct. 1991.
- [3] I. Roytelman and S. Shahidehpour, "State estimation for electric power distribution systems in quasi real-time conditions," *IEEE Trans. Power Del.*, vol. 8, no. 4, pp. 2009–2015, Oct. 1993.
- [4] A. S. Meliopoulos and F. Zhang, "Multiphase power flow and state estimation for power distribution systems," *IEEE Trans. Power Syst.*, vol. 11, no. 2, pp. 939–946, May 1996.
- [5] K. Li, "State estimation for power distribution system and measurement impacts," *IEEE Trans. Power Syst.*, vol. 11, no. 2, pp. 911–916, May 1996.
- [6] C. Lu, J. Teng, and W.-H. Liu, "Distribution system state estimation," *IEEE Trans. Power Syst.*, vol. 10, no. 1, pp. 229–240, Feb. 1995.
- [7] M. Baran and A. Kelley, "State estimation for real-time monitoring of distribution systems," *IEEE Trans. Power Syst.*, vol. 9, no. 3, pp. 1601–1609, Aug. 1994.
- [8] H. Wang and N. Schulz, "A revised branch current-based distribution system state estimation algorithm and meter placement impact," *IEEE Trans. Power Syst.*, vol. 19, no. 1, pp. 207–213, Feb. 2004.
- [9] C. Hansen and A. Debs, "Power system state estimation using three-phase models," *IEEE Trans. Power Syst.*, vol. 10, no. 2, pp. 818–824, May 1995.
- [10] A. Rankovi, B. M. Maksimovi, and A. T. Sari, "A three-phase state estimation in active distribution networks," *Int. J. Elect. Power Energy Syst.*, vol. 54, pp. 154–162, Jan. 2014.

- [11] C. Muscas, S. Sulis, A. Angioni, F. Ponci, and A. Monti, "Impact of different uncertainty sources on a three-phase state estimator for distribution networks," *IEEE Trans. Instrum. Meas.*, vol. 63, no. 9, pp. 2200–2209, Sep. 2014.
- [12] P. P. Barbeiro, H. Teixeira, J. Krstulovic, J. Pereira, and F. Soares, "Exploiting autoencoders for three-phase state estimation in unbalanced distribution grids," *Elect. Power Syst. Res.*, vol. 123, pp. 108–118, Jun. 2015.
- [13] A. Meliopoulos, B. Fardanesh, and S. Zelingher, "Power system state estimation: Modeling error effects and impact on system operation," in *Proc. 34th Annu. Hawaii Int. Conf. Syst. Sci.*, Maui, HI, USA, Jan. 2001, pp. 682–690.
- [14] S. Zhong and A. Abur, "Effects of nontransposed lines and unbalanced loads on state estimation," in *Proc. IEEE Power Eng. Soc. Winter Meeting*, vol. 2, New York, NY, USA, 2002, pp. 975–979.
- [15] D. Haughton and G. Heydt, "A linear state estimation formulation for smart distribution systems," *IEEE Trans. Power Syst.*, vol. 28, no. 2, pp. 1187–1195, May 2013.
- [16] D. Thukaram, J. Jerome, and C. Surapong, "A robust three-phase state estimation algorithm for distribution networks," *Elect. Power Syst. Res.*, vol. 55, no. 3, pp. 191–200, 2000.
- [17] M. F. M. Júnior, M. A. Almeida, M. C. Cruz, R. V. Monteiro, and A. B. Oliveira, "A three-phase algorithm for state estimation in power distribution feeders based on the powers summation load flow method," *Elect. Power Syst. Res.*, vol. 123, pp. 76–84, Jun. 2015.
- [18] I. Dzafic, D. Ablakovic, and S. Henselmeyer, "Real-time three-phase state estimation for radial distribution networks," in *Proc. IEEE Power Energy Soc. Gen. Meeting*, San Diego, CA, USA, Jul. 2012, pp. 1–6.
- [19] R. Pires, L. Mili, and F. Lemos, "Constrained robust estimation of power system state variables and transformer tap positions under erroneous zero-injections," *IEEE Trans. Power Syst.*, vol. 29, no. 3, pp. 1144–1152, May 2014.
- [20] M. Shiroie and S. Hosseini, "Observability and estimation of transformer tap setting with minimal PMU placement," in *Proc. IEEE Power Energy Soc. Gen. Meeting Convers. Del. Elect. Energy 21st Century*, Pittsburgh, PA, USA, Jul. 2008, pp. 1–4.
- [21] S. Wang, X. Cui, Z. Li, and M. Shahidehpour, "An improved branch current-based three-phase state estimation algorithm for distribution systems with DGs," in *Proc. IEEE Innov. Smart Grid Technol. Asia (ISGT Asia)*, Tianjin, China, May 2012, pp. 1–6.
- [22] A. Abur and A. Gomez-Exposito, *Power System State Estimation: Theory and Implementation*. New York, NY, USA: Marcel Dekker, 2004.
- [23] Y. Fukuyama, "State estimation and optimal setting of voltage regulator in distribution systems," in *Proc. IEEE Power Eng. Soc. Winter Meeting*, vol. 2, Columbus, OH, USA, 2001, pp. 930–935.
- [24] P. Teixeira, S. R. Brammer, W. L. Rutz, W. C. Merritt, and J. L. Salmonsén, "State estimation of voltage and phase-shift transformer tap settings," in *Proc. Conf. Power Ind. Comput. Appl. Conf.*, Baltimore, MD, USA, May 1991, pp. 416–422.
- [25] G. Korres, P. J. Katsikas, and G. C. Contaxis, "Transformer tap setting observability in state estimation," *IEEE Trans. Power Syst.*, vol. 19, no. 2, pp. 699–706, May 2004.
- [26] H. Maalouf, R. A. Jabra, and M. Awada, "Mixed-integer quadratic programming based rounding technique for power system state estimation with discrete and continuous variables," *Elect. Power Compon. Syst.*, vol. 41, no. 5, pp. 555–567, 2013.
- [27] M. Liu, S. K. Tso, and Y. Cheng, "An extended nonlinear primal-dual interior-point algorithm for reactive-power optimization of large-scale power systems with discrete control variables," *IEEE Trans. Power Syst.*, vol. 17, no. 4, pp. 982–991, Nov. 2002.
- [28] A. Arefi, M. R. Haghifam, and S. H. Fathi, "Distribution harmonic state estimation based on a modified PSO considering parameters uncertainty," in *Proc. IEEE Trondheim PowerTech*, Trondheim, Norway, Jun. 2011, pp. 1–7.
- [29] K. Lee and J. Park, "Application of particle swarm optimization to economic dispatch problem: Advantages and disadvantages," in *Proc. IEEE PES Power Syst. Conf. Expo. (PSCE)*, Atlanta, GA, USA, Oct. 2006, pp. 188–192.
- [30] P. Angeline, "Using selection to improve particle swarm optimization," in *Proc. IEEE Int. Conf. Evol. Comput. Proc. IEEE World Congr. Comput. Intell.*, Anchorage, AK, USA, May 1998, pp. 84–89.
- [31] S. Naka, T. Genji, T. Yura, and Y. Fukuyama, "A hybrid particle swarm optimization for distribution state estimation," *IEEE Trans. Power Syst.*, vol. 18, no. 1, pp. 60–68, Feb. 2003.
- [32] M. R. AlRashidi, M. F. AlHajri, and M. E. El-Hawary, "Enhanced particle swarm optimization approach for solving the non-convex optimal power flow," *World Acad. Sci. Eng. Technol.*, vol. 4, no. 2, pp. 580–584, 2010.
- [33] J. Kennedy and R. Eberhart, "Particle swarm optimization," in *Proc. IEEE Int. Conf. Neural Netw.*, vol. 4, Perth, WA, Australia, Nov. 1995, pp. 1942–1948.
- [34] F. van den Bergh, "An analysis of particle swarm optimizers," Ph.D. dissertation, Dept. Comput. Sci., Univ. Pretoria, Pretoria, South Africa, Nov. 2001.
- [35] Y. Shi and R. Eberhart, "A modified particle swarm optimizer," in *Proc. IEEE Int. Conf. Evol. Comput. World Congr. Comput. Intell.*, Anchorage, AK, USA, May 1998, pp. 69–73.
- [36] A.-R. Ghasemi, R. Ebrahimi, A. Babaei, and M. Hoseynpoor, "A modified Newton-Raphson algorithm of three-phase power flow analysis in unsymmetrical distribution networks with distributed generation," *J. Basic Appl. Sci. Res.*, vol. 3, no. 9, pp. 36–46, Sep. 2013.
- [37] W. H. Kersting, *Distribution System Modeling and Analysis*. Boca Raton, FL, USA: CRC Press, 2002.
- [38] K. Wang *et al.*, "Research on time-sharing ZIP load modeling based on linear BP network," in *Proc. 5th Int. Conf. Intell. Human Mach. Syst. Cybern. (IHMSC)*, vol. 1, Hangzhou, China, pp. 37–41, Aug. 2013.
- [39] W. Kersting, "Radial distribution test feeders," in *Proc. IEEE Power Eng. Soc. Winter Meeting*, vol. 2, Columbus, OH, USA, 2001, pp. 908–912.
- [40] W. H. Kersting, "Radial distribution test feeders," IEEE PES Distrib. Syst. Anal. Subcommit., Tech. Rep. 975, 2000.
- [41] K. Samarakoon, J. Wu, J. Ekanayake, and N. Jenkins, "Use of delayed smart meter measurements for distribution state estimation," in *Proc. IEEE Power Energy Soc. Gen. Meeting*, San Diego, CA, USA, Jul. 2011, pp. 1–6.
- [42] H.-M. Jeong, H.-S. Lee, and J.-H. Park, "Application of parallel particle swarm optimization on power system state estimation," in *Proc. Asia Pac. Transmiss. Distrib. Conf. Expo.*, Oct. 2009, pp. 1–4.



Sara Nanchian (S'12) received the M.Sc. degree in electrical power engineering from the University of Manchester, Manchester, U.K., in 2008. She is currently pursuing the Ph.D. degree with the Department of Electrical and Electronic Engineering, Imperial College London, London, U.K.

Her current research interests include state estimation for active distribution network.



Ankur Majumdar (S'12) received the B.E.E. (Hons.) degree in electrical engineering from Jadavpur University, Kolkata, India, in 2009, and the M.Tech. degree in electric power systems from the Indian Institute of Technology Delhi, New Delhi, India, in 2011. He is currently pursuing the Ph.D. degree with the Department of Electrical and Electronic Engineering, Imperial College London, London, U.K.

He is currently a Research Assistant with the Department of Electrical and Electronic Engineering, Imperial College London. His current research interests include state estimation, smart grid security, and power system analysis.



Bikash C. Pal (M'00–SM'02–F'13) received the B.E.E. (Hons.) degree from Jadavpur University, Kolkata, India, in 1990; the M.E. degree from the Indian Institute of Science, Bengaluru, India, in 1992; and the Ph.D. degree from Imperial College London, London, U.K., in 1999, all in electrical engineering.

He is currently a Professor with the Department of Electrical and Electronic Engineering, Imperial College London. His current research interests include state estimation, power system dynamics, and flexible ac transmission system controllers.

Dr. Pal is the Editor-in-Chief of the IEEE TRANSACTIONS ON SUSTAINABLE ENERGY.