

Received July 13, 2020, accepted July 28, 2020, date of publication August 6, 2020, date of current version August 19, 2020.

Digital Object Identifier 10.1109/ACCESS.2020.3014684

Robust PI Control of Interval Plants With Gain and Phase Margin Specifications: Application to a Continuous Stirred Tank Reactor

RADEK MATUŠŮ¹, BILAL ŞENOL², (Member, IEEE), AND LIBOR PEKAŘ³

¹Centre for Security, Information and Advanced Technologies (CEBIA-Tech), Faculty of Applied Informatics, Tomas Bata University in Zlín, 760 01 Zlín, Czech Republic

²Department of Computer Engineering, Faculty of Engineering, İnönü University, 44280 Malatya, Turkey

³Department of Automation and Control Engineering, Faculty of Applied Informatics, Tomas Bata University in Zlín, 760 01 Zlín, Czech Republic

Corresponding author: Radek Matusů (rmatusu@utb.cz)

This work was supported in part by the CEBIA-Tech Instrumentation Project through the European Regional Development Fund under Grant CZ.1.05/2.1.00/19.0376, and in part by the National Sustainability Programme of Ministry of Education, Youth, and Sports, Czech Republic, under Project LO1303 (MSMT-7778/2014).

ABSTRACT The paper is focused on robust Proportional-Integral (PI) control of interval plants with gain and phase margin specifications and on the application of this approach to a Continuous Stirred Tank Reactor (CSTR). More specifically, the work aims at the determination of PI controller parameter regions, for which not only robust stability but also some level of robust performance of the closed-loop control system is guaranteed, and this robust performance is represented by the required gain and phase margin that has to be ensured for all potential members of the interval family of controlled plants, even for the worst case. The applied technique is based on the combination of the previously published generalization of stability boundary locus method (for specified gain and phase margin under the assumption of fixed-parameter plants) with the sixteen plant theorem. This extension enables the direct application of the method to design the robustly performing PI controllers for interval plants. The effectiveness of the improved method is demonstrated on a CSTR, modeled as the interval plant, for which the robust stability and robust performance regions are obtained.

INDEX TERMS Robust control, PI controllers, continuous stirred tank reactor, robust stability, robust performance, gain margin, phase margin, interval plant.

I. INTRODUCTION

The controlled plants that are burden with nonlinear, high-order, or other complex behavior, imprecise knowledge of their physical properties, or changeability of parameters are commonly modeled in a simplified way as the linear time-invariant (LTI) systems with interval uncertainty, in short, as the interval plants. It means the plants are described by the linear differential equations or corresponding transfer functions with coefficients that can vary (“slowly” in time) within given bounds (intervals), where the coefficients change independently on each other. The principal advantage of this approach is that all the mentioned aspects are supposed to be covered by the interval plant family and that the popular

techniques of linear robust control can be utilized for analysis and synthesis of the relevant control systems.

According to an unpublished Honeywell survey from 2000, 97% of control systems in the chemicals, refining, and pulp and paper industries utilize a Proportional-Integral-Derivative (PID) algorithm [1]. The control community expects that the rate of PID controllers and their special cases (such as PI and PD) in industrial control applications exceeds 90% even nowadays [2]. Thus, it is still worth researching on the tuning of PI(D) controllers, especially for systems under uncertainty. Obviously, the application of robustly stabilizing or robustly performing PI(D) controllers for interval plants, or more generally, for systems with parametric uncertainty, represents an attractive research field [3], [4], because these relatively simple LTI models with uncertainty may cover a wide spectrum of real-world controlled systems.

The associate editor coordinating the review of this manuscript and approving it for publication was Rongni Yang.

Great attention has been paid to the development of the methods for obtaining sets of parameters of (nominally) stabilizing PI(D) controllers for various plants. For example, D-decomposition method, which was revisited in [5], the parameter space approach [6], the singular frequency method [7], the Hermite-Biehler approach [4], or stability boundary locus-based method [8], [9] belong among the most popular techniques. However, there are many other alternative methods available in the literature. Several of them will be mentioned in the following sentences. The computation of all stabilizing PI(D) controllers by using the Kronecker summation method was presented in [10]. A Nyquist plot-based technique for calculation of KP-stable regions was developed in [11] (for time delay and PI controller parameters) and [12] (for PID controller parameters). A Lyapunov equation-based stability mapping approach can be found in [13], [14]. A combined approach to determine robustly stabilizing parameter spaces was proposed in [15]. Naturally, a range of results is focused on the stabilization of time-delay plants. In addition to some of the abovementioned works that are also applicable to time-delay systems, it is worth mentioning [16], [17]. Moreover, PI(D) controller design based on generalized stability boundary locus for various types of time-delay plants was introduced in [18], [19], [20]. Furthermore, there are also overview papers available, such as [21], which compared the parameter space approach and the Hermite-Biehler theorem-based approach.

Many of the abovementioned methods may be extended in order to be applicable for some kind of systems with parametric uncertainty, frequently for the case of interval plants. Thus, the robust stability is requested instead of the (nominal) stability. A typical tool that is employed in this regard is the sixteen plant theorem [22], [23]. This extreme point-based result allows the determination of robustly stabilizing controllers through the simultaneous stabilization of sixteen Kharitonov plants. However, it is valid only for the first-order controllers (such as PI controllers). If the PID controller is used, some more general non-extremal results have to be applied, such as Kharitonov segments (see, e.g., [24]), which are known from the generalized Kharitonov theorem [25] and similar thirty-two edge theorem [23], [25].

Despite the fact that robust stability is the fundamental requirement, a certain level of performance is usually also demanded in practical control applications. If the performance needs to be ensured even for the worst case from the family of controlled plants, one speaks about robust performance. The classical measures of control system performance are, among others, well-known gain margin and phase margin. Their utilization in the robust performance context was studied, e.g., in [26]–[30]. Stabilization of a fixed-parameter plant for specified gain and phase margins through the stability boundary locus method was presented in [9], [31]. Some other approaches to mapping the performance requirements into the parameter space can be found in [32]–[34].

Chemical reactors can be seen as the center of all chemical process industries [35]. Their control represents a nontrivial task since they usually suffer from complicated behavior and possible safety problems. The classical idealized types of reactors include batch reactor, Continuous Stirred Tank Reactor (CSTR), and plug flow reactor. A CSTR contains a vessel surrounded by a jacket for heating or cooling, an agitator for (perfect) mixing inside the vessel, feed lines that enter, and a liquid product stream that exits the vessel. A composition and a temperature of the product stream are the same as the contents of the liquid throughout the vessel. For more details, see [36].

Control of CSTRs is the essential and deeply studied discipline, and robust control techniques provide the promising results in this regard. For example, the application of robust static output feedback control to a CSTR was presented in [37]. The same CSTR, described by a model with interval uncertainty, was robustly stabilized by means of PI controller either via stability boundary locus method in [38] or via Kronecker summation method in [39]. Possible approaches to designing robust PID controllers for CSTRs can be found, e.g., in [40], [41]. Furthermore, the paper [42] provides a comparison of three robust control methods for use in CSTR control. An example of an alternative approach, represented by the linear matrix inequalities-based robust model predictive control, was addressed in [43].

This paper deals with robust control of interval plants using PI controllers with gain and phase margin specifications. Thus, it focuses on finding the regions of PI controller parameters, where not only closed-loop robust stability but also some level of closed-loop robust performance, represented by the required gain and phase margin, is ensured for all potential members from the interval family of controlled plants. In fact, this work intends to extend the interesting results published previously in the papers [9], [31], where the generalization of stability boundary locus method for specified gain and phase margins is introduced and further discussed, but where the presented applications are limited to the controlled plants with fixed parameters. The current article combines the mentioned technique with the sixteen plant theorem, which allows its direct utilization for the interval plants. The application of the improved method is demonstrated on a CSTR, which is described by the linearized mathematical model with interval uncertainty, i.e., the robust performance region of PI controller parameters for given gain and phase margin specifications is obtained. Note that the same interval plant model was robustly stabilized by PI controllers using various methods in [38], [39], but the present paper addresses not only robust stability but also robust performance problem.

The article is structured as follows. The existing stability boundary locus method for the robust stabilization of interval plants through PI controllers is reminded in Section 2. Then, Section 3 adopts the generalization of this stabilization approach, which allows the additional gain and phase margin specifications, and extends the idea for interval plants.

The extensive Section 4 applies the modified method to a CSTR. Namely, the mathematical model is presented, and the relevant robust stability and robust performance regions are determined in this Section. The final Section 5 brings some concluding remarks.

II. ROBUST STABILIZATION OF INTERVAL PLANTS VIA PI CONTROLLERS

Assume the fundamental closed-loop control system with an interval plant, which is shown in Fig. 1.

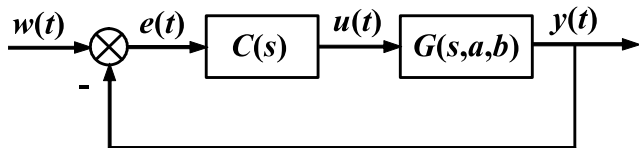


FIGURE 1. Feedback control loop with an interval plant.

In accordance with the conventions, the signals $w(t)$, $e(t)$, $u(t)$ and $y(t)$ from Fig. 1 represent the reference signal, control (tracking) error, control (actuating) signal and controlled (output) signal, respectively. The block $C(s)$ symbolizes an ordinary PI controller in the form:

$$C(s) = P + \frac{I}{s} = \frac{Ps + I}{s} \quad (1)$$

and the block $G(s, a, b)$ is a strictly proper interval plant:

$$G(s, b, a) = \frac{B(s, b)}{A(s, a)} \quad (2)$$

with the numerator and denominator polynomials:

$$B(s, b) = \sum_{i=0}^m [b_i^-, b_i^+] s^i \quad (3)$$

$$A(s, a) = s^n + \sum_{i=0}^{n-1} [a_i^-, a_i^+] s^i \quad (4)$$

where superscripts “-” and “+” denote the lower and upper bounds of the relevant parameters, respectively, and where $m < n$.

The robust stabilization of interval plant (2) by means of PI controller (1) can be solved using simple but elegant extreme-based result known as the sixteen plant theorem [22], [23]. According to this principle, a first-order controller (in most practical cases PI controller (1)) robustly stabilizes the interval plant (2) if and only if this controller stabilizes each of the sixteen Kharitonov plants. Note that the Kharitonov plants:

$$G_{k,l}(s) = \frac{B_k(s)}{A_l(s)}, \quad k, l \in \{1, 2, 3, 4\} \quad (5)$$

can be easily assembled by taking the Kharitonov polynomials of the numerator (B_1 to B_4) and denominator (A_1 to A_4) polynomials. All combinations (four polynomials in the numerator, and four in the denominator) lead to the mentioned sixteen Kharitonov plants. Remind that the

Kharitonov polynomials for the numerator polynomial (3) are constructed as follows [44]:

$$\begin{aligned} B_1(s) &= b_0^- + b_1^- s + b_2^+ s^2 + b_3^+ s^3 + \dots \\ B_2(s) &= b_0^+ + b_1^+ s + b_2^- s^2 + b_3^- s^3 + \dots \\ B_3(s) &= b_0^+ + b_1^- s + b_2^- s^2 + b_3^+ s^3 + \dots \\ B_4(s) &= b_0^- + b_1^+ s + b_2^+ s^2 + b_3^- s^3 + \dots \end{aligned} \quad (6)$$

and, naturally, the scheme is analogous for the denominator polynomial (4) as well.

Thus, the problem of robust stabilization of an interval plant may be transformed into the task of simultaneous stabilization of sixteen (or less in special cases) “ordinary” plants with fixed parameters. Now, the attention will be turned to this partial stabilization.

A relatively simple but effective graphical approach for the determination of the stabilizing PI controller based on obtaining the stability boundary locus [8], [9] will be utilized.

Consider a fixed-parameter plant given by a standard transfer function (e.g., consider one of the Kharitonov plants, but the subscripts k and l will be omitted for simplicity in the following equations), in which the numerator and denominator polynomials are decomposed into their even and odd parts, and the complex variable s is substituted by $j\omega$:

$$G(j\omega) = \frac{B_E(-\omega^2) + j\omega B_O(-\omega^2)}{A_E(-\omega^2) + j\omega A_O(-\omega^2)} \quad (7)$$

The subscripts “E” and “O” symbolize even and odd parts of the numerator or denominator polynomials, respectively.

In further steps, the closed-loop characteristic polynomial of the feedback system with controller (1) and the decomposed plant (7) is calculated, and its real and imaginary parts are equaled to zero (for more details see [8], [9]). This results in the equations for the proportional and integral parameters:

$$\begin{aligned} P(\omega) &= \frac{X_5(\omega)X_4(\omega) - X_6(\omega)X_2(\omega)}{X_1(\omega)X_4(\omega) - X_2(\omega)X_3(\omega)} \\ I(\omega) &= \frac{X_6(\omega)X_1(\omega) - X_5(\omega)X_3(\omega)}{X_1(\omega)X_4(\omega) - X_2(\omega)X_3(\omega)} \end{aligned} \quad (8)$$

where

$$\begin{aligned} X_1(\omega) &= -\omega^2 B_O(-\omega^2) \\ X_2(\omega) &= B_E(-\omega^2) \\ X_3(\omega) &= \omega B_E(-\omega^2) \\ X_4(\omega) &= \omega B_O(-\omega^2) \\ X_5(\omega) &= \omega^2 A_O(-\omega^2) \\ X_6(\omega) &= -\omega A_E(-\omega^2) \end{aligned} \quad (9)$$

The contemporaneous solution of the parametric relations (8) for an appropriate set of frequencies ω defines the stability boundary locus in the P-I plane. The resulting parametric curve and the line $I = 0$ divide the P-I plane into the regions of stability or instability. The stable areas can be ascertained simply by choosing a test point within each region. Remind that the final stability region need not be a convex set. Although the technique is quite fast and effective,

proper frequency gridding may represent an important issue. Nevertheless, the range of inspected frequencies can be reduced by means of the Nyquist plot-based method from [45], which is utilized in [8], [9], according to which the change of stability to instability and vice versa may occur only at frequencies that fulfill:

$$\text{Im}[G(j\omega)] = 0 \quad (10)$$

To sum up, the sixteen stability regions obtained via the above-described procedure, one for each of the sixteen Kharitonov plants (5), need to be plotted in the P-I plane, and their mutual intersection defines the final robust stability region, that is the region of parameters of PI controllers (1) that robustly stabilize the interval plant (2).

III. ADDITIONAL GAIN AND PHASE MARGIN SPECIFICATIONS

Stabilization of a plant model with fixed parameters for specified gain and phase margins has been presented in [9], [31]. The technique uses the feedback control loop that is enriched by a virtual gain-phase margin tester $Me^{-j\theta}$ [26], [27], [30]. Such a feedback loop with an interval plant is shown in Fig. 2.

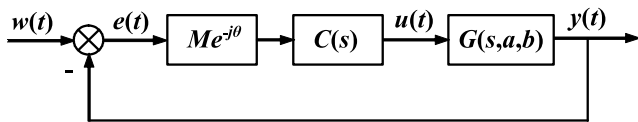


FIGURE 2. Feedback control loop with an interval plant and gain-phase margin tester.

First, assume a controlled plant in the form of standard transfer function with fixed parameters, i.e., assume that $G(s, a, b)$ in Fig. 2 is replaced by $G(s)$ and consequently rewritten to (7). Following the analogous procedure as outlined in Section 2, the stability boundary locus (or rather performance boundary locus in this case) for PI controllers (1) can be computed by solving the parametric equations (8) simultaneously, but now a set of relations (9) is modified to [9]:

$$\begin{aligned} X_1(\omega) &= M \left(\omega B_E(-\omega^2) \sin \theta - \omega^2 B_O(-\omega^2) \cos \theta \right) \\ X_2(\omega) &= M \left(B_E(-\omega^2) \cos \theta + \omega B_O(-\omega^2) \sin \theta \right) \\ X_3(\omega) &= M \left(\omega B_E(-\omega^2) \cos \theta + \omega^2 B_O(-\omega^2) \sin \theta \right) \\ X_4(\omega) &= M \left(\omega B_O(-\omega^2) \cos \theta - B_E(-\omega^2) \sin \theta \right) \\ X_5(\omega) &= \omega^2 A_O(-\omega^2) \\ X_6(\omega) &= -\omega A_E(-\omega^2) \end{aligned} \quad (11)$$

The performance boundary locus for a selected gain margin M can be obtained by equaling θ to zero in (11), whereas assuming that $M = 0$ results in the performance boundary locus for a chosen phase margin θ . The intersection of two relevant performance regions (the first one for guaranteed minimum gain margin, and the second one for guaranteed


minimum phase margin) leads to the region that ensures the given minimum gain margin and phase margin at the same time.

The papers [9] and [31] used this approach for the “stabilization” of a fixed-parameter plant. Nevertheless, this work extends the idea and applies the technique to an interval plant. It was proved that the sixteen plant theorem is valid not “only” for the robust stability, but the performance specifications (such as gain margin and phase margin) are also satisfied [46], [4], [23]. For example, it was shown that the worst-case H_∞ norm is related to one of the sixteen Kharitonov plants [47], [48], [23]. Moreover, it was presented that the outer boundary of the Nyquist envelope of a strictly proper stable interval plant is covered by the Nyquist plots of the sixteen Kharitonov plants [49], [50]. All in all, the worst-case gain margin and phase margin of the feedback control system with a first-order controller (typically PI controller (1)) and a strictly proper interval plant (2) can be determined on the basis of gain margins and phase margins of the related sixteen Kharitonov plants. A combination of this fact with the stability boundary locus-based method [9] will be applied to designing a robust PI controller for a CSTR in the following Section 4.

IV. APPLICATION TO A CONTINUOUS STIRRED TANK REACTOR

A. MATHEMATICAL MODEL OF A CONTINUOUS STIRRED TANK REACTOR

Propylene glycol is an organic compound that is industrially produced by the hydrolysis of propylene oxide with an excess of water [51]. This hydrolysis in a CSTR has been selected as a controlled process [37], [52], [38], [39]. The corresponding chemical reaction is described by the equation:



Not only the reactants (propylene glycol and water) but also methanol is fed in a CSTR, in order to increase the propylene oxide solubility in water. The surplus water assures higher selectiveness to propylene glycol and removes consecutive reactions of propylene glycol with propylene oxide. The reaction has first-order kinetics with regard to propylene oxide as a crucial component. The dependence of the reaction rate constant on the temperature can be expressed by the Arrhenius law:

$$k = k_\infty e^{-\frac{E}{RT_r}} \quad (13)$$

where k is the reaction rate constant, k_∞ represents the pre-exponential factor, E stands for the activation energy, R means the universal gas constant, and T_r signifies the temperature of the reaction mixture [37], [52], [38], [39].

Suppose that a CSTR is ideally mixed, reacting volume is constant, and the volumetric flow rate of the inlet stream equals to the volumetric flow rate of the outlet stream. Then, the mass balance for any species of the system is given as:

$$V_r \frac{dc_n}{dt} = q_r (c_{n0} - c_n) + V_r v_n r, \quad n = 1, 2, 3 \quad (14)$$

where V_r represents the reacting volume, c_n stands for the molar concentration of the n th component, c_{n0} means the feed molar concentration of the n th component, q_r signifies the volumetric flow rate of the reaction mixture, v_n is the stoichiometric coefficient of the n th component, and $r = kc_{C_3H_6O}$ determines the molar ratio of the chemical reaction [37], [52], [38], [39].

Moreover, it is supposed that the particular heat capacities, densities, and volumetric flow rates are independent of temperature or mixture composition. Furthermore, the mixing volume and the heat of mixing are assumed to be neglected. Thus, the simplified enthalpy balances of the reaction mixture and the cooling medium are, respectively [53], [37], [38], [39]:

$$V_r \rho_r c_{pr} \frac{dT_r}{dt} = q_r \rho_r c_{pr} (T_{r0} - T_r) - UA (T_r - T_c) + V_r (-\Delta_r H^o) r \quad (15)$$

$$V_c \rho_c c_{pc} \frac{dT_c}{dt} = q_c \rho_c c_{pc} (T_{c0} - T_c) + UA (T_r - T_c) \quad (16)$$

where T stands for the temperature, ρ means the density, c_p represents the specific heat capacity, $\Delta_r H^o$ is the reaction enthalpy, U signifies the overall heat transfer coefficient, and A stands for the heat exchange area. Moreover, the subscript symbols have the following meaning: 0 represents the feed, c is the cooling medium, and r means the reaction mixture.

The values of steady-state inputs and constant parameters can be found in [37], [38] (see Table 1 in these papers). Besides, there are three physical parameters, namely reaction enthalpy, pre-exponential factor, and overall heat transfer coefficient, that may vary within the intervals. Their minimum, maximum, and mean values are presented again in works [37], [38] (see Table 2 in them).

The linearized single-input single-output model of the CSTR, with the reaction mixture flow rate q_r [m³min⁻¹] as the control input (the other inputs are constant) and the reaction mixture temperature T_r [K] as the controlled output, was introduced in [38] and studied in [39] as well. The model is given by the fourth-order transfer function:

$$G(s, b, a) = \frac{b_2 s^2 + b_1 s + b_0}{s^4 + a_3 s^3 + a_2 s^2 + a_1 s + a_0} \quad (17)$$

whose parameters are supposed to vary within the following bounds:

$$\begin{aligned} b_2 &\in [-0.0291, -0.0245] \\ b_1 &\in [-0.0199, -0.0127] \\ b_0 &\in [-0.0005740, -0.0003549] \\ a_3 &\in [0.5801, 0.9030] \\ a_2 &\in [0.1002, 0.2299] \\ a_1 &\in [0.0062, 0.0142] \\ a_0 &\in [0.0001094, 0.0002412] \end{aligned} \quad (18)$$

To summarize, the utilized mathematical model of a controlled process in the CSTR is given by the family of plants

with interval uncertainty (17), (18), i.e., by the interval plant for short.

B. ROBUST STABILITY

First, one of the Kharitonov plants (5) of the interval plant (17) with the uncertain coefficients (18) will be chosen, and the region of stabilizing PI controllers will be calculated and plotted.

Consider, e.g., the Kharitonov plant $G_{4,2}(s)$:

$$\begin{aligned} G_{4,2}(s) &= \frac{B_4(s)}{A_2(s)} = \frac{b_2^+ s^2 + b_1^+ s + b_0^-}{s^4 + a_3^- s^3 + a_2^- s^2 + a_1^+ s + a_0^+} \\ &= \frac{-0.0245s^2 - 0.0127s - 0.000574}{s^4 + 0.5801s^3 + 0.1002s^2 + 0.0142s + 0.0002412} \end{aligned} \quad (19)$$

The even and odd parts of the polynomials in numerator or denominator of the transfer function in the form (7) are as follows:

$$\begin{aligned} B_E(-\omega^2) &= 0.0245\omega^2 - 0.000574 \\ B_O(-\omega^2) &= -0.0127 \\ A_E(-\omega^2) &= \omega^4 - 0.1002\omega^2 + 0.0002412 \\ A_O(-\omega^2) &= -0.5801\omega^2 + 0.0142 \end{aligned} \quad (20)$$

Substituting (20) into (9) and (8) leads to the parametric equations for the proportional and integral gain of the PI controller. Their simultaneous solution for a range of nonnegative frequencies ω results in the stability boundary locus. The attained curve together with $I = 0$ line splits the P-I plane into the stability and instability regions that are depicted in the P-I plane in Fig. 3.

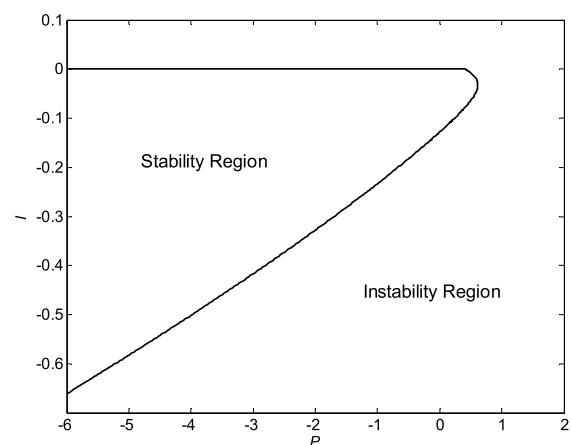


FIGURE 3. Stability region for the Kharitonov plant (19).

In order to obtain the robust stability region for the original interval plant (17), (18), the previous procedure has to be repeated, and the partial stability regions need to be calculated for all remaining fifteen Kharitonov plants. Fig. 4 shows the resulting set of sixteen stability regions.

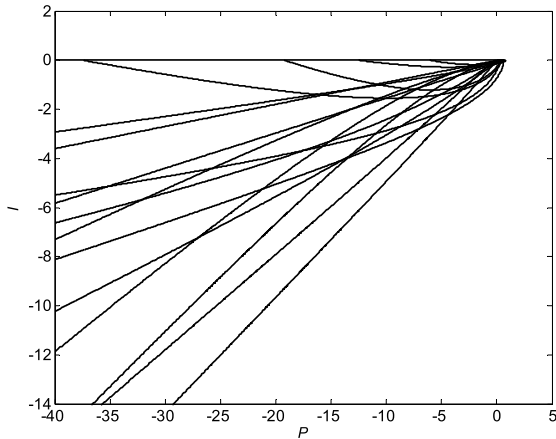


FIGURE 4. Stability regions for all sixteen Kharitonov plants of (17).

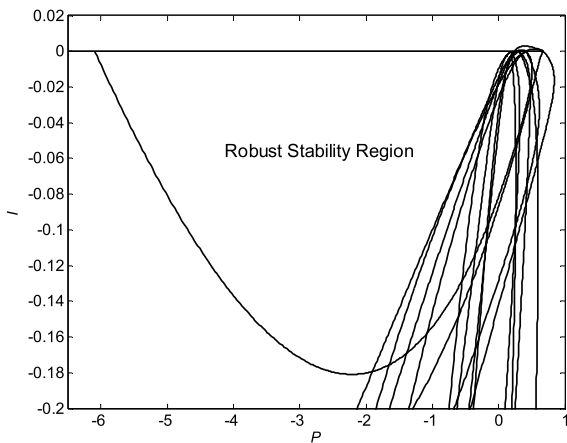


FIGURE 5. Robust stability region for the interval plant (17), (18).

The zoomed version of Fig. 4 can be seen in Fig. 5. It offers a closer look at the intersection of the sixteen stability regions that defines the robust stability region.

So, all PI controllers (1) with the parameters P and I lying inside the robust stability region shown in Fig. 5 guarantee that the interval plant (17), describing the CSTR, is stabilized by the feedback loop (Fig. 1) for all possible parameters (18).

C. ROBUST PERFORMANCE

In the next step, the aim is to find a set of PI controllers that are not only robustly stabilizing, but that also ensure the required level of robust performance, expressed by the minimum gain margin and phase margin for the worst-case member of the interval plant family.

For the initial demonstration, assume the same Kharitonov plant $G_{4,2}(s)$ with the transfer function (19) as in the previous sub-section 4.2. Thus, the even and odd parts of the numerator and denominator of (7) are again in the form (20). Then, the parts (20) are used in the modified set of auxiliary variables (11), where M and θ are the chosen gain margin and phase margin, respectively, and subsequently, (11) is put into the parametric equations (8).

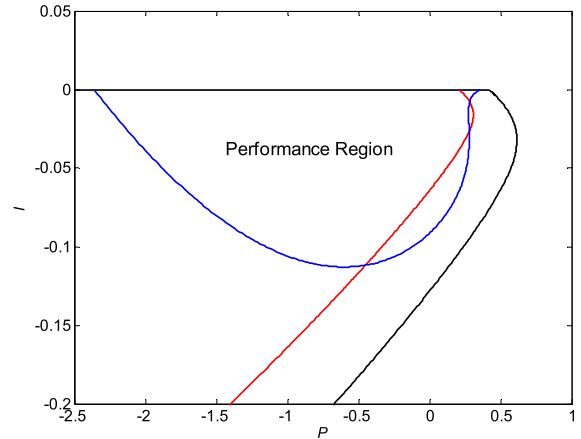


FIGURE 6. Performance region for $M > 2$ (≈ 6 dB) and $\theta > 30^\circ$ for the Kharitonov plant (19).

Assume the gain margin $M = 2$ (≈ 6 dB) and phase margin $\theta = 30^\circ$.

First, both cases will be examined separately. The performance boundary locus for $M = 2$ is drawn in Fig. 6 by the red curve. The left-hand side area from this red curve represents the region in which the gain margin is guaranteed to be greater than 2. Moreover, the performance boundary locus for $\theta = 30^\circ$ is depicted in Fig. 6 by using the blue curve. The interior of the blue shape (with the upper limit given by the line $I = 0$) defines the region with the phase margin greater than 30° .

The intersection of the red gain margin region and the blue phase margin region from Fig. 6 delimits the region in which the minimum gain margin 2 and minimum phase margin 30° are guaranteed at the same time. By way of illustration, Fig. 6 contains the stability region from Fig. 3 as well (black curve).

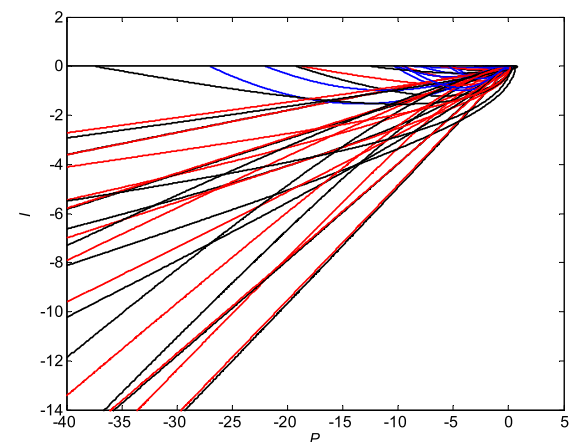


FIGURE 7. Gain margin regions (red curves), phase margin regions (blue curves), and stability regions (black curves) for all sixteen Kharitonov plants of (17).

The location of the robust performance region for the original interval plant (17) with the uncertain coefficients (18) demands the repetition of this procedure for the remaining fifteen Kharitonov plants. The Fig. 7 depicts the set of sixteen

gain margin regions (red curves), phase margin regions (blue curves), and stability regions (black curves – for the complete idea).

The intersection of all thirty-two gain and phase margin regions leads to the final robust performance region, which is zoomed in Fig. 8.

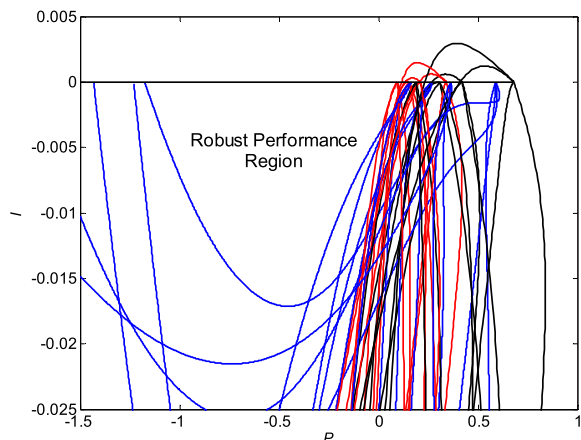


FIGURE 8. Robust performance region for the interval plant (17), (18).

Thus, all PI controllers (1) with the parameters P and I located inside the robust performance region from Fig. 8 ensure not only robust stabilization of a CSTR modeled by the interval plant (17), (18), but furthermore, it guarantees the minimum gain margin 2 and the minimum phase margin 30° even for the worst-case member of the interval plant family.

V. CONCLUSION

This paper was aimed at the computation of robustly performing PI controllers with prescribed gain and phase margin specifications for interval plants. The roots of the presented method lie in the existing principle, known as the stability boundary locus method, which was extended in order to generate robust performance regions of PI controller parameters for interval plants. Subsequently, this approach was applied to a mathematical model of a CSTR with interval uncertainty. In the examples, this model was not only robustly stabilized but also robust performance region with the minimum gain margin 2 and the minimum phase margin 30° for all members of the interval plant family was found.

Note that the proposed method does not provide one specific optimal PI controller, but it gives the whole set of the robustly performing PI controllers that fulfill given specifications (if such controllers exist), and so the final choice depends on other user preferences. The method itself does not suffer from conservatism, and the obtained robust performance regions are valid exactly for the interval plants, but a conservatism may be presented due to potentially circumspect modeling of a real-world controlled system (such as nonlinearly behaving CSTR) by an LTI system with interval uncertainty.

Potential future research may be oriented to further progress in the area of robust performance of the feedback control loops with interval plants and PID controllers.

REFERENCES

- [1] L. Desborough and R. Miller, "Increasing customer value of industrial control performance monitoring-Honeywell's experience," in *Proc. 6th Int. Conf. Chem. Process Control*, vol. 326, 2002, pp. 169–189.
- [2] *What is the Percentage of the PID Algorithm Applications in Industry*. Accessed: Feb. 13, 2020. [Online]. Available: https://www.researchgate.net/post/What_is_the_percentage_of_the_PID_algorithm_applications_in_industry
- [3] S. P. Bhattacharyya, "Robust control under parametric uncertainty: An overview and recent results," *Annu. Rev. Control*, vol. 44, pp. 45–77, 2017.
- [4] S. P. Bhattacharyya, A. Datta, L. H. Keel, *Linear Control Theory: Structure, Robustness, and Optimization*. Boca Raton, FL, USA: CRC Press, 2009.
- [5] E. N. Gryazina and B. T. Polyak, "Stability regions in the parameter space: D-decomposition revisited," *Automatica*, vol. 42, no. 1, pp. 13–26, Jan. 2006.
- [6] J. Ackermann, *Robust Control: The Parameter Space Approach*. London, U.K.: Springer-Verlag, 2002.
- [7] N. Bajcinca, "Design of robust PID controllers using decoupling at singular frequencies," *Automatica*, vol. 42, no. 11, pp. 1943–1949, Nov. 2006.
- [8] N. Tan and I. Kaya, "Computation of stabilizing PI controllers for interval systems," in *Proc. 11th Medit. Conf. Control Automat.*, Rhodes, Greece, 2003, pp. 1–8.
- [9] N. Tan, I. Kaya, C. Yeroglu, and D. P. Atherton, "Computation of stabilizing PI and PID controllers using the stability boundary locus," *Energy Convers. Manage.*, vol. 47, nos. 18–19, pp. 3045–3058, Nov. 2006.
- [10] J. Fang, D. Zheng, and Z. Ren, "Computation of stabilizing PI and PID controllers by using kronecker summation method," *Energy Convers. Manage.*, vol. 50, no. 7, pp. 1821–1827, Jul. 2009.
- [11] E. Almodaresi and M. Bozorg, "KP-stable regions in the space of time delay and PI controller coefficients," *Int. J. Control*, vol. 88, no. 3, pp. 653–662, Mar. 2015.
- [12] E. Almodaresi and M. Bozorg, "KP-stable regions in the space of PID controller coefficients," *IET Control Theory Appl.*, vol. 11, no. 10, 2017, pp. 1642–1647.
- [13] I. Mutlu, F. Schrödel, N. Bajcinca, D. Abel, and M. T. Söylemez, "Lyapunov equation based stability mapping approach: A MIMO case study," *IFAC-PapersOnLine*, vol. 49, no. 9, pp. 130–135, 2016.
- [14] I. Mutlu, F. Schrödel, D. Mihailescu-Stoica, K. Alaa, and M. T. Söylemez, "A case study on determining stability boundaries of parameter uncertain systems," in *Proc. 26th Medit. Conf. Control Autom. (MED)*, Zadar, Croatia, Jun. 2018, pp. 1–6.
- [15] K. Alaa, I. Mutlu, F. Schrödel, D. Mihailescu-Stoica, and R. Voßwinkel, "A combined approach to determine robustly stabilizing parameter spaces," in *Proc. 27th Medit. Conf. Control Autom. (MED)*, Akko, Israel, Jul. 2019, pp. 106–111.
- [16] N. Hohenbichler, "All stabilizing PID controllers for time delay systems," *Automatica*, vol. 45, no. 11, pp. 2678–2684, Nov. 2009.
- [17] N. Bajcinca, "Computation of stable regions in PID parameter space for time delay systems," in *Proc. 5th IFAC Workshop Time-Delay Syst.*, Leuven, Belgium, 2004.
- [18] I. Kaya and S. Atiç, "PI controller design based on generalized stability boundary locus," in *Proc. 20th Int. Conf. Syst. Theory, Control Comput. (ICSTCC)*, Sinaia, Romania, Oct. 2016, pp. 24–28.
- [19] S. Atiç and I. Kaya, "PID controller design based on generalized stability boundary locus to control unstable processes with dead time," in *Proc. 26th Medit. Conf. Control Autom. (MED)*, Zadar, Croatia, Jun. 2018, pp. 1–6.
- [20] S. Atiç, E. Cokmez, F. Peker, and I. Kaya, "PID controller design for controlling integrating processes with dead time using generalized stability boundary locus," *IFAC-PapersOnLine*, vol. 51, no. 4, pp. 924–929, 2018.

- [21] F. Schrödel, S. K. Manickavasagam, and D. Abel, "A comparative overview of different approaches for calculating the set of all stabilizing PID controller parameters," *IFAC-PapersOnLine*, vol. 48, no. 14, pp. 43–49, 2015.
- [22] B. R. Barmish, C. V. Hollot, F. J. Kraus, and R. Tempo, "Extreme point results for robust stabilization of interval plants with first-order compensators," *IEEE Trans. Autom. Control*, vol. 37, no. 6, pp. 707–714, Jun. 1992.
- [23] B. R. Barmish, *New Tools for Robustness of Linear Systems*. New York, NY, USA: Macmillan, 1994.
- [24] R. Matušů and R. Prokop, "Computation of robustly stabilizing PID controllers for interval systems," *SpringerPlus*, vol. 5, no. 1, p. 702, Dec. 2016, doi: 10.1186/s40064-016-2341-z.
- [25] H. Chapellat and S. P. Bhattacharyya, "A generalization of Kharitonov's theorem; robust stability of interval plants," *IEEE Trans. Autom. Control*, vol. 34, no. 3, pp. 306–311, Mar. 1989.
- [26] Y. J. Huang and Y.-J. Wang, "Robust PID tuning strategy for uncertain plants based on the kharitonov theorem," *ISA Trans.*, vol. 39, no. 4, pp. 419–431, Sep. 2000.
- [27] Y.-J. Wang, "Graphical computation of gain and phase margin specifications-oriented robust PID controllers for uncertain systems with time-varying delay," *J. Process Control*, vol. 21, no. 4, pp. 475–488, Apr. 2011.
- [28] X.-W. Zhao and J.-Y. Ren, "Computation of PID stabilizing region with stabilized margins," *Opt. Precis. Eng.*, vol. 21, no. 12, pp. 3214–3222, 2013.
- [29] Y.-J. Wang, S.-C. Wu, Y.-J. Hong, C.-Z. Gao, and J.-T. Lin, "Computation of all robust PID controllers for two-input and two-output time delay control systems with gain margin and phase margin specifications," in *Proc. 32nd Chin. Control Conf.*, Xi'an, China, 2013, pp. 5614–5619.
- [30] Y.-J. Wang, "Determination of all feasible robust PID controllers for open-loop unstable plus time delay processes with gain margin and phase margin specifications," *ISA Trans.*, vol. 53, no. 2, pp. 628–646, Mar. 2014.
- [31] C. Yeroglu and N. Tan, "Design of robust PI controller for vehicle suspension system," *J. Electr. Eng. Technol.*, vol. 3, no. 1, pp. 135–142, Mar. 2008.
- [32] T. Bünte, "Mapping of nyquist/popov theta-stability margins into parameter space," *IFAC-PapersOnLine*, vol. 33, no. 14, pp. 519–524, 2000.
- [33] D. Odenthal and P. Blue, "Mapping of frequency response performance specifications into parameter space," *IFAC-PapersOnLine*, vol. 33, no. 14, pp. 531–536, 2000.
- [34] L. Pyta, R. Voßwinkel, F. Schrödel, N. Bajcinca, and D. Abel, "Parameter space approach for performance mapping using Lyapunov stability," in *Proc. 26th Medit. Conf. Control Autom. (MED)*, Zadar, Croatia, Jun. 2018, pp. 1–9.
- [35] I. D. G. Chaves, J. R. G. López, J. L. G. Zapata, A. L. Robayo, and G. R. Niño, "Chemical Reactors," in *Process Analysis and Simulation in Chemical Engineering*. Cham, Switzerland: Springer, 2016, pp. 195–240.
- [36] W. L. Luyben, *Chemical Reactor Design and Control*. Hoboken, NJ, USA: Wiley, 2007.
- [37] M. Bakošová, D. Puna, P. Dostál, and J. Závacká, "Robust stabilization of a chemical reactor," *Chem. Papers*, vol. 63, no. 5, pp. 527–536, Jan. 2009.
- [38] J. Závacká, M. Bakošová, and K. Vaneková, "Design of robust PI controllers for control of an exothermic chemical reactor," in *Proc. 14th WSEAS Int. Conf. Syst.*, Corfu, Greece, 2010, pp. 1–8.
- [39] R. Matušů, J. Závacká, R. Prokop, and M. Bakošová, "The kronecker summation method for robust stabilization applied to a chemical reactor," *J. Control Sci. Eng.*, vol. 2011, pp. 1–7, 2011.
- [40] S. S. Kumar and C. Shreesha, "Design of robust PID controller for a CSTR plant with interval parametric uncertainty using kharitonov theorem," in *Proc. Int. Conf. Comput. Power, Energy Inf. Communication (ICCPCEIC)*, Chennai, India, Apr. 2016, pp. 430–433.
- [41] S. U. Doiphode, A. B. Divekar, N. N. Ghadigaonkar, and A. N. Gangurde, "Design of robust PID controller for level control of CSTR with safety interlocks," in *Proc. 2nd Int. Conf. Intell. Comput. Control Syst. (ICICCS)*, Madurai, India Jun. 2018, pp. 841–845.
- [42] A. Vasičkaninová, M. Bakošová, L. Čírka, and M. Kalúz, "Comparison of robust control techniques for use in continuous stirred tank reactor control," *IFAC-PapersOnLine*, vol. 48, no. 14, pp. 284–289, 2015.
- [43] J. Oravec, M. Bakošová, and L. Hanulová, "Experimental investigation of robust MPC design with integral action for a continuous stirred tank reactor," in *Proc. IEEE Conf. Decision Control (CDC)*, Miami Beach, FL, USA, Dec. 2018, pp. 2611–2616.
- [44] V. L. Kharitonov, "Asymptotic stability of an equilibrium position of a family of systems of linear differential equations," *Differentsial'nye Uravneniya*, vol. 14, pp. 2086–2088, Oct. 1978.
- [45] M. T. Söylemez, N. Munro, and H. Baki, "Fast calculation of stabilizing PID controllers," *Automatica*, vol. 39, no. 1, pp. 121–126, Jan. 2003.
- [46] F. Asadi, *Robust Control of DC-DC Converters: The Kharitonov's Theorem Approach with MATLAB Codes*. Washington, DC, USA: Morgan & Claypool, 2018.
- [47] T. Mori and S. Barnett, "On stability tests for some classes of dynamical systems with perturbed coefficients," *IMA J. Math. Control Inf.*, vol. 5, no. 2, pp. 117–123, 1988.
- [48] H. Chapellat, M. A. Dahleh, and S. P. Bhattacharyya, "Robust stability under structured and unstructured perturbations," *IEEE Trans. Autom. Control*, vol. 35, no. 10, pp. 1100–1108, May 1990.
- [49] C. V. Hollot and R. Tempo, "On the nyquist envelope of an interval plant family," *IEEE Trans. Autom. Control*, vol. 39, no. 2, pp. 391–396, Oct. 1994.
- [50] N. Tan and D. P. Atherton, "A user friendly toolbox for the analysis of interval systems," in *Proc. 3rd IFAC Symp. Robust Control Des.*, Prague, Czech Republic, 2000, pp. 1–8.
- [51] S. M. López-Zamora, I. Dobrosz-Gómez, and M. Á. Gómez-García, "Stability criteria and critical runway conditions of propylene glycol manufacture in a continuous stirred tank reactor," *Ingeniería e Investigación*, vol. 35, no. 2, pp. 56–60, Aug. 2015, doi: 10.15446/ing.investig.v35n2.46258.
- [52] A. Molnár, J. Markoš, and L. Jelemenský, "Accuracy of mathematical model with regard to safety analysis of chemical reactors," *Chem. Papers*, vol. 56, no. 6, 2002, pp. 357–361.
- [53] J. Ingham, I. J. Dunn, E. Heinze, J. E. Přenosil, J. B. Snape, *Chemical Engineering Dynamics: An Introduction to Modelling and Computer Simulation*. Hoboken, NJ, USA: Wiley, 2007.



RADEK MATUŠŮ was born in Zlín, Czech Republic, in 1978. He received the M.S. degree in automation and control technology in consumer goods industry from the Faculty of Technology, Tomas Bata University (TBU) in Zlín, in 2002, and the Ph.D. degree in technical cybernetics from the Faculty of Applied Informatics (FAI), TBU in Zlín, in 2007.

He was appointed as an Associate Professor of machine and process control at FAI, TBU in Zlín, in 2018. He has been holding various research or pedagogical positions with the TBU in Zlín, since 2004, where he is currently a Researcher and a Project Manager. He has authored or coauthored more than 50 scientific journal articles and over 110 conference contributions. His research interests include analysis and synthesis of robust control systems, fractional-order systems, and algebraic methods in control design.

Prof. Matušů serves as an Academic Editor for the *Journal of Control Science and Engineering*, and he was a Guest Editor of *Mathematical Problems Engineering*. He has also served as a Reviewer for over 40 scientific journals including but not limited to *Automatica*, the IEEE TRANSACTIONS ON AUTOMATIC CONTROL, and the *IEEE Control Systems Magazine*.



BILAL ŞENOL (Member, IEEE) received the B.S. and M.S. degrees in electrical and electronics engineering, and the Ph.D. degree in computer engineering from İnönü University, Malatya, Turkey, in 2009, 2011, and 2015, respectively.

He is currently working as an Associate Professor with the Department of Computer Engineering, İnönü University. His research interests include fractional-order analysis and controller design. He also works related to computer-aided design and user-friendly interfaces for system analysis.



LIBOR PEKAŘ was born in Zlín, Czech Republic, in 1979. He received the B.S. degree in automation and informatics, and the M.S. degree in automation and control engineering in consumption industries and the Ph.D. degree in technical cybernetics from Tomas Bata University in Zlín, Czech Republic, in 2002, 2005, and 2013, respectively.

From 2006 to 2013, he worked at the university as a junior lecturer. He became a senior lecturer there, in 2013, and was appointed as an Associate

Professor, in 2018. He is an Associate Professor with the Faculty of Applied Informatics, Tomas Bata University in Zlín. He has authored six book chapters, more than 45 journal articles, and 70 conference papers. His research interests include analysis, modeling, identification, and control of time-delay systems, algebraic control methods, autotuning, and optimization techniques. He served as the Lead Guest Editor for the special issues of *Advances in Mechanical Engineering* journal and *Mathematics* journal.

Prof. Pekař received the Laureate of the ASR Seminary Instrumentation and Control, in 2007 and 2009, and the Rectors' Award for the Best Ph.D. Thesis from the Faculty of Applied Informatics, Tomas Bata University in Zlín, in 2013. He has been an Editor of *Mathematical Problems in Engineering*, since 2018. He has served as a Reviewer for contributions to many highly regarded journals such as *Applied Mathematics and Computation*, *ESAIM: Control, Optimisation, and Calculus of Variations*, the IEEE TRANSACTIONS ON AUTOMATIC CONTROL, the IEEE TRANSACTIONS ON INDUSTRIAL ELECTRONICS, the *International Journal of Control*, the *International Journal of Robust and Nonlinear Control, Systems and Control Letters*, *Swarm and Evolutionary Computation*, and many others.

• • •