

RESEARCH ARTICLE

Partial Discharge Detection in Pressboards Immersed in Mineral Insulation Oil With Quantum Well Hall Effect Magnetic Field Sensors

FATİH ATALAR¹, EMRAH DOKUR^{2,3}, ERTAN BALABAN⁴,
MOHAMED MISSOUS⁴, (Senior Member, IEEE), AND MUKDEN UĞUR⁵

¹Department of Electrical and Electronics Engineering, Istanbul University-Cerrahpaşa, 34320 Istanbul, Turkey

²MaREI-SFI Research Centre for Energy, Climate and Marine, University of College Cork, Cork, P43 C573 Ireland

³Faculty of Engineering, Bilecik Şeyh Edebali University, 11230 Bilecik, Turkey

⁴Department of Electrical and Electronic Engineering, The University of Manchester, Manchester M13 9PL, U.K.

⁵Department of Robotics and Intelligent Systems, Institute of Science, Turkish-German University, 34820 Istanbul, Turkey

Corresponding author: Emrah Dokur (edokur@ucc.ie)

ABSTRACT Insulation degradation may cause inefficient and faulty operation of transformers. The insulation failures in transformers mostly start with a Partial Discharge (PD) event. For both operational and cost reasons to ensure the best performance and functionality of transformers, early detection of PD events is of great importance. In this paper presents a novel PD detection technique by using a highly sensitive Quantum Well Hall Effect (QWHE) magnetic field sensor and compares the findings with an off-the-shelf silicon magnetic field transducer. The investigation of the QWHE for high voltage engineering problem such as PD detection is given first time in this paper. The aim of the study is to detect PD activity in pressboards immersed in mineral insulation oil experimentally using a new QWHE sensor. The measured experimental data from both sensors are decomposed by Empirical Mode Decomposition (EMD) and Wavelet Decomposition (WD) methods, and PD signals are analyzed comparatively. The results show that QWHE sensors provide more accurate and noise-free measurements allowing early and more accurate PD detections.

INDEX TERMS Empirical mode decomposition, hall effect sensor, partial discharge, quantum well sensor, wavelet decomposition.

I. INTRODUCTION

Operational reliability is an important aspect of modern power system management. System reliability heavily depends on component failures. Insulation problems caused by operation under high voltage are a major reason of physical damages and system failures.

Real-time monitoring can help early detection of these problems and hence improve system reliability and reduce operational costs. In this context, the determination of partial discharges (PD) in insulation materials is of great importance. For system reliability and cost reduction, especially, PD from

the breakdown process of mineral oil and pressboard insulators used in transformers must be examined and modelled.

Electrical, thermal stresses and severe environmental conditions can cause degradation in dielectric properties of the pressboard insulators and mineral oil. It is worth noting that PD does not mean total dielectric breakdown in the electrical insulation system. However, during the PD electrical charges gradually increase because of degradation in insulation properties of materials. This eventually causes a full electrical discharge making the dielectric material conductive, and hence may lead to system failure [1].

In [2] researchers used a needle-plane electrode configuration to examine this effect in mineral oil-pressboard interfaces under different voltage levels by using an Omicron MPD600 PD system and reported the correlation between interfacial

The associate editor coordinating the review of this manuscript and approving it for publication was Guillaume Parent.

polarization and static electrification. They applied a voltage between 30 kV and 40 kV to an oil-impregnated pressboard insulator to investigate this effect. The moisture of the insulator is reported as 3%. Researchers have used the term “tree formation” for partial discharges that occur on the bulk of the solid insulator, and the “tracking” for partial discharges on the surface. They also concluded that significant electrical discharges may take place in the insulator without breakdown.

Surface discharges from mineral oil and pressboard interface might be an indication of serious failures [4]. Aging occurs in transformer oil as a result of electrical, thermal, mechanical stresses and structural problems that the transformer is exposed to during its operating life. Significant reductions in insulation performance of aging transformer oil may occur. Catastrophic errors were investigated in a study of 30 kV constant voltage applied to an oil-impregnated paperboard insulator [5]. Researchers obtained data on the PD load-time axis every 10 minutes. It was concluded that the formation of white spots was only an initial mechanism in the process until complete discharge within the scope of the PD phenomenon, and did not affect the PD values very much.

In [6] researchers investigated the effect of aging in transformer oil on PD by using three different mineral oils. In the first stage of the experiment, they used pristine oil as an insulator. In the second stage, they used aged oil taken from a 120 MVA rated transformer with 220/110 kV which had reached the end of its operating life. The third choice was aged oil obtained by applying synthetic methods in the laboratory. As one would expect, the aged oil taken from the transformer was loaded with less partial discharge load.

PD detection methods can be classified as electrical and nonelectrical methods [7]. The electrical methods consist of the impulse-shaped noise signal and harmonics waves. Measuring acoustic waves or heat and gas formation analysis are examples of nonelectrical PD detection methods [8]. In acoustic estimation techniques, the detection of PD is highly prone to mechanical vibrations. Harmonic waves distort the magnetic field and make PD detection difficult. Magnetic field measurements can be a viable option for precision PD and its characteristics detection in transformer insulation systems. In general, electromagnetic waves formed during the sudden PD formation can be detected by various types of antennas. The electromagnetic wave generated by PD formation was detected and analyzed by using a patch antenna [9]. This antenna design used UHF sensors in order to observe wideband high-frequency PD signals within the range of 300 MHz to 3 GHz. During the PD occurrence in the insulation material, different types of resonance characteristics can be observed in the generated electromagnetic wave pattern, which makes sensors calibration quite challenging. In [10] a magnetic probe-based measurement method for PD in large AC motors is presented. Although PD was detected, one obstacle encountered in this study was the size of the magnetic probe, which was not suitable to be inserted in

the small gap between mineral oil and pressboard in the transformer.

The electron and ion accumulation inside the insulator leads to electron avalanches, and thereby some points of the magnetic field signals are corrupted by noise. Examination of these corruptive signals can be used to assess and quantify the formation of partial discharges. Different methods have been proposed in the literature in order to investigate the effects of PD and corona discharges on different insulator materials [11], [12].

In this paper, AC magnetic field changes in pressboard and mineral oil used as insulators in transformers have been investigated for PD analysis. For this purpose, we compared and analysed the performance of two magnetic field sensors, namely, the commercially available SS49E Linear Hall Effect sensor [13] and quantum well hall effect (QWHE) magnetic field sensors developed by Advanced Hall Sensors Ltd [14]. In addition, the data received from both sensors are decomposed by Empirical Mode Decomposition (EMD) and Wavelet Decomposition (WD) methods, and PD signals are observed and analysed. We demonstrate that compared to commercial silicon parts, the QWHE sensors provide more accurate data for non-destructive analysis of PD phenomenon. In addition, a low-cost PD detection and analysis method that can easily be applied to HV transformers is presented.

Section 2 presents the structure of the QWHE sensors. In Section 3 a test setup is described in detail. EMD and WD signal decomposition methods are described in detail in Section 4. Results obtained from both sensors are evaluated comparatively in the fifth and final section.

II. QUANTUM WELL HALL EFFECT SENSORS

Hall-effect sensors are used to detect magnetic fields. Most state-of-the-art Hall-effect sensors are silicon-based. This allows easy integration of sensor with conditioning electronics, which is required for both excitation and amplification. However, silicon limits the sensor sensitivity due to low carrier mobility [15]. In comparison, the QWHE magnetic field sensors are based on GaAs. They have a higher carrier mobility compared to silicon that makes them more sensitive. This is achieved by the formation of a Quantum Well (QW) channel that is a thin layer of a narrow band-gap semi-conductor sandwiched between two larger band-gap materials [16]. Sensors used in this study are P2A model manufactured by Advanced Hall Sensors Ltd [14] and were grown by Solid Source Molecular Beam Epitaxy in a VG V90H system. A thin layer of In 0.18 Ga 0.82 As is sandwiched between two layers of Al 0.35 Ga 0.65 As and GaAs. Fig. 1 shows the structure of QWHE sensor [16].

Sensitivity of the QWHE magnetic field sensors is $1 \mu\text{T}$ at DC and $<10 \text{ nT}$ at higher frequencies [17]. The noise figure for QWHE sensors is similar to that of GMR and AMR sensors, but with a superior linearity, and much better dynamic range exceeding 180 dB, making these sensors a good candidate for PD analysis.

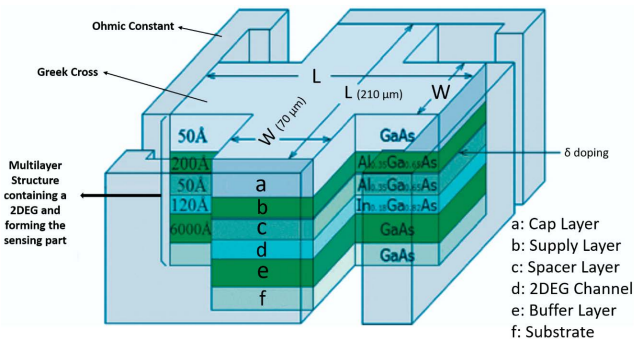


FIGURE 1. Structure of quantum well hall effect sensor.

III. EXPERIMENTAL DESIGN

A. TEST CONFIGURATION

The main purpose of this paper is to compare two Hall effect sensors for magnetic PD detection and analysis. In order to compare the sensitivity of these two different sensors during PD in pressboard insulator, a high voltage experiment set-up was used. The partial discharge phenomenon in a power transformer contains detection, measurement, classification, and localization. Pressboard and mineral oil are used together for protection against electrical and thermal stresses in transformers windings. PD measurements are carried out based on IEC 60641-2 (Pressboard and press paper for electrical purposes - Part 2: Methods of tests) [17] and IEC 60270 (IEC 60270 International Standard: High-Voltage Test Techniques–Partial Discharge Measurements) [18]. The experiment is conducted on the test apparatus of pressboard under the magnetic field generated by a constant high voltage AC level.

The experimental set-up consists of a high voltage apparatus. The schematic diagram of the test set-up is shown in Fig. 2. In this figure, the distances belonging to the test chamber are in mm range.

To get an adjustable voltage between 0-220 V a variac with a maximum power of 5 kVA is fed with 220 V/50 Hz AC input. In order to obtain high voltage, a voltage transformer having 220 V/ 40 kV turn ratio with 1,5 kVA power rating is used. The primary side or low voltage windings of the transformer is supplied from the output of the variac. This configuration allowed us to obtain an adjustable high voltage at the secondary windings of the transformer in accordance with turn ratio. Fig. 3 shows the picture of the overall setup.

In order to protect the system from high current and voltage, a 1 MΩ protective resistor is used for connection after the high voltage windings [20]. The resistor is connected to an electrode by using a co-axial cable. A rod-plane electrode configuration is used in this study. The rod electrode is made from brass with a diameter of 9 mm and length of 140 mm. The tip point of the rod electrode is of 0.5 mm thickness. Earth electrode has a planar plate structure with dimensions of 150 × 170 × 3 mm. This electrode is also made from brass. The chamber holding the mineral oil and pressboard

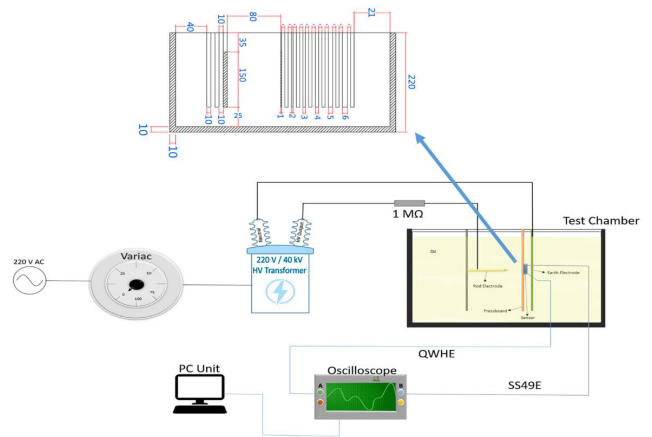


FIGURE 2. Schematic diagram of test set-up.

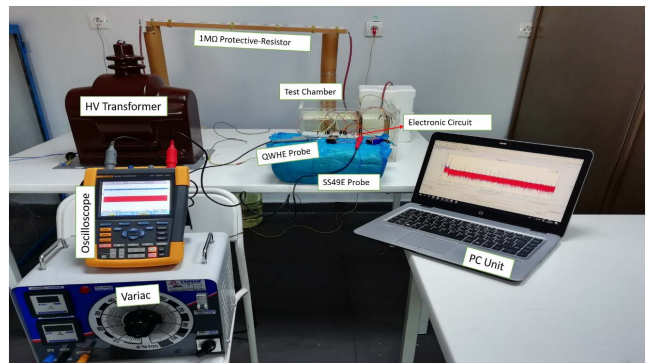


FIGURE 3. Experimental set-up.

is made from plexiglass material. The dimensions and wall thickness of the chamber are 300 × 180 × 220 mm and 10 mm, respectively. Care has been taken to prevent any leakage from the test chamber.

The pressboard is of 150 × 170 mm dimension and it has fiber density of 1.2g/cm³ and a relative dielectric constant of $\epsilon_r = 4.1$. The relative dielectric constant of mineral oil is $\epsilon_r = 2.2$. The mineral oil used is pristine. This oil is widely used as an insulator in transformer windings. The distance between thtip point of high voltage electrode and pressboard is 1mm while earth electrode and pressboard have 4 mm. These distances were ensured by the specific test chamber. All these distances were adjusted exactly by the adaptive test chamber. Hence, there is no manual arrangement or adjustment to get exact distances mentioned above.

The AC magnetic field is measured by two different Hall Effect Sensors, namely, the commercially available SS49E from Honeywell [13] and the QWHE magnetic field sensors designed and fabricated by the research group at the University of Manchester [15]–[17]. As can be seen from Figure 2, the sensor is located exactly at the middle point of the pressboard, on the back surface where it looks at the ground electrode. The front side of the sensor is put on pressboard. Taking into consideration the working voltage, current and tolerance of both sensors two different amplifier

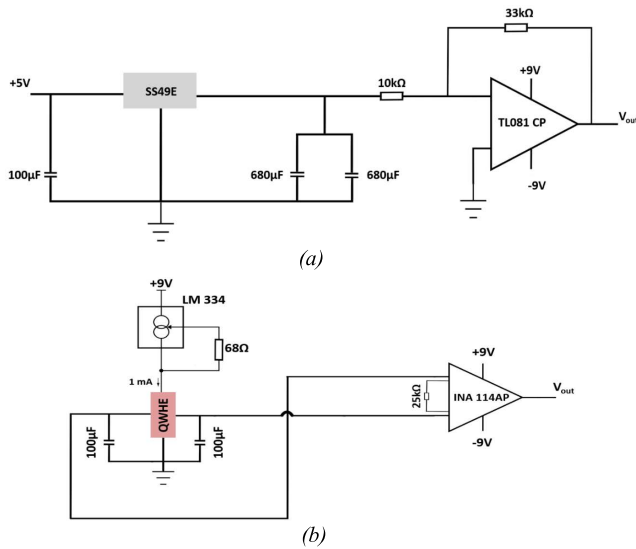


FIGURE 4. Amplifier circuits for (a) SS49E and (b) QWHE.

circuits, which are recommended by manufacturers, were implemented for each one separately to get more accurate measurements. These circuits are shown in Fig.4 (a) and (b), respectively. The output of an instrumentation amplifier is read by a 500 MHz bandwidth Fluke 190-504S portable oscilloscope. In addition, the oscilloscope is connected to a host PC to upload the acquired raw data.

IV. DECOMPOSITION METHODS

A. WAVELET DECOMPOSITION

Wavelet Decomposition (WD) is a mathematical processing method proposed to analyze the original signals by decomposition into various frequencies/sub-layers. Wavelet transform usually decomposes a signal into an approximation component and many detail components.

A CWT for an original signal $f(t)$ with respect to a mother wavelet function $w(t)$ can be defined as [21], [22]:

$$CWT_f = \langle f(t), \Psi_{a,b}(t) \rangle = \int_{-\infty}^{+\infty} f(t) \frac{1}{\sqrt{|a|}} \Psi^* \left(\frac{t-b}{a} \right) dt \quad (1)$$

where a is a scale coefficient and b is a translation coefficient * denotes the complex conjugate.

A wavelet decomposition tree showing the decomposition process is shown in Fig.5. Firstly, the signal s is decomposed into an approximation component a_1 and a detail component d_1 ; and then the a_1 is further decomposed into another approximation component a_2 and a detail component d_2 and this decomposition repeats same process steps if we want to analyze the signal with higher level resolution.

B. EMPIRICAL MODE DECOMPOSITION

The EMD (Empirical Mode Decomposition) is a time domain signal decomposing method, proposed by Huang in 1998 [23]. It not only makes the signal decomposition unique but

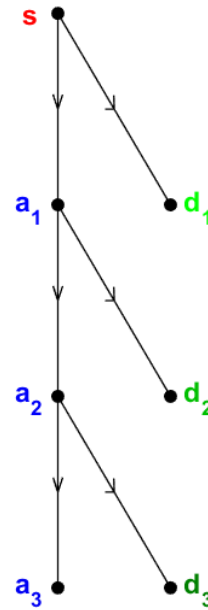


FIGURE 5. Wavelet tree schematic diagram of decomposition.

also has good local characteristics both in time domain and frequency domain. The EMD method finds extensive applications in the power systems and renewable energy studies for preprocessing.

Given an original series $\{Y(t)\}$, it can be described with the following Equation (2) after the EMD calculation.

$$Y(t) = \sum_{i=1}^n C_i(t) + R_n(t) \quad (2)$$

where $\{C_i(t)\}$, $i=1,2,\dots,n$ is the Intrinsic Mode Function (IMF) in different decompositions and $\{R_n(t)\}$ is the residue after n numbers of IMFs are derived.

An IMF satisfies the following two properties [24]:

(i) The number of extrema and the number of zero crossing in a whole sampled data set must either be equal or differ at most by one;

(ii) At any point, the mean value of the envelope defined by the local maxima and the local minima is zero.

A sifting alternative process is employed to extract the separate components IMFs. The detailed steps of the sifting calculation can be demonstrated as follows [25]:

a) Identify all local extrema of series $\{Y(t)\}$, including local maxima and local minima.

b) Connect all local maxima by a cubic spline line to generate its upper envelop $\{Y_{up}(t)\}$. Similarly, the lower envelop $\{Y_{low}(t)\}$ is made with all local minima.

c) Compute the mean envelop $\{M(t)\}$ from the upper and lower envelopes by using the following equation:

$$M(t) = \frac{[Y_{up}(t) + Y_{low}(t)]}{2} \quad (3)$$

d) Extract the details as follows (Equation 4):

$$Z(t) = Y(t) - M(t) \quad (4)$$

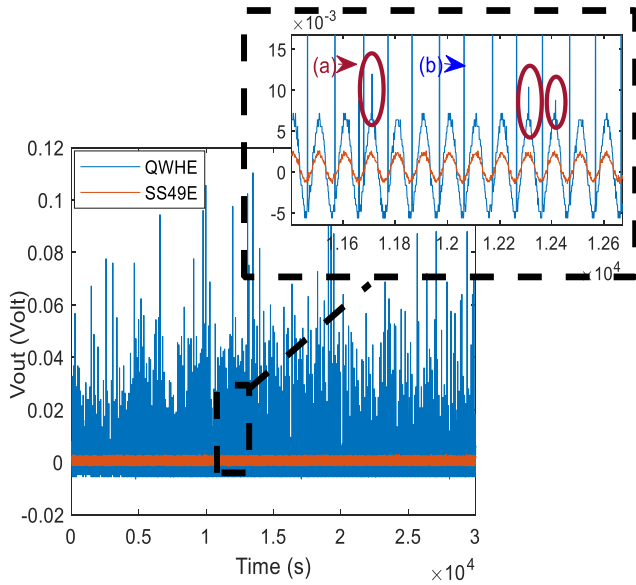


FIGURE 6. The test results of QWHE and SS49E.

e) Check whether $\{Z(t)\}$ is an IMF: (i) if $\{Z(t)\}$ is an IMF then set $C(t)=Z(t)$ and meantime replace $\{Y(t)\}$ with the residual $R(t)=X(t)-C(t)$; (ii) if $\{Z(t)\}$ is not an IMF, replace $\{Y(t)\}$ with $\{Z(t)\}$ then repeat Steps b-d until the termination criterion is satisfied. Equation 5 can be regarded as the termination condition of this iterative calculation:

$$\sum_{t=1}^m \frac{[Z_{j-1}(t) - Z_j(t)]^2}{[Z_{j-1}(t)]^2} \leq \delta (j = 1, 2, \dots; t = 1, 2, \dots, m) \tag{5}$$

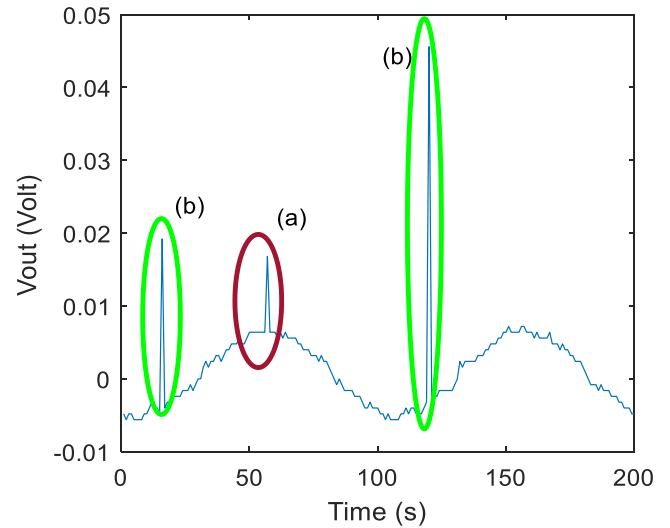


FIGURE 7. PD and shielding signals of the experimental setup with QWHE.

where m is the length of signal, δ is the terminated parameter, which is usually set as 0.2-0.3, and j denotes the times of iterative calculation. The δ is usually determined by the requirements of applications.

f) The procedure of steps a-e is repeated until all IMFs are found.

V. RESULTS AND DISCUSSION

In this section, the performance of the SS49E and QWHE sensors in the context of partial discharge detection has been

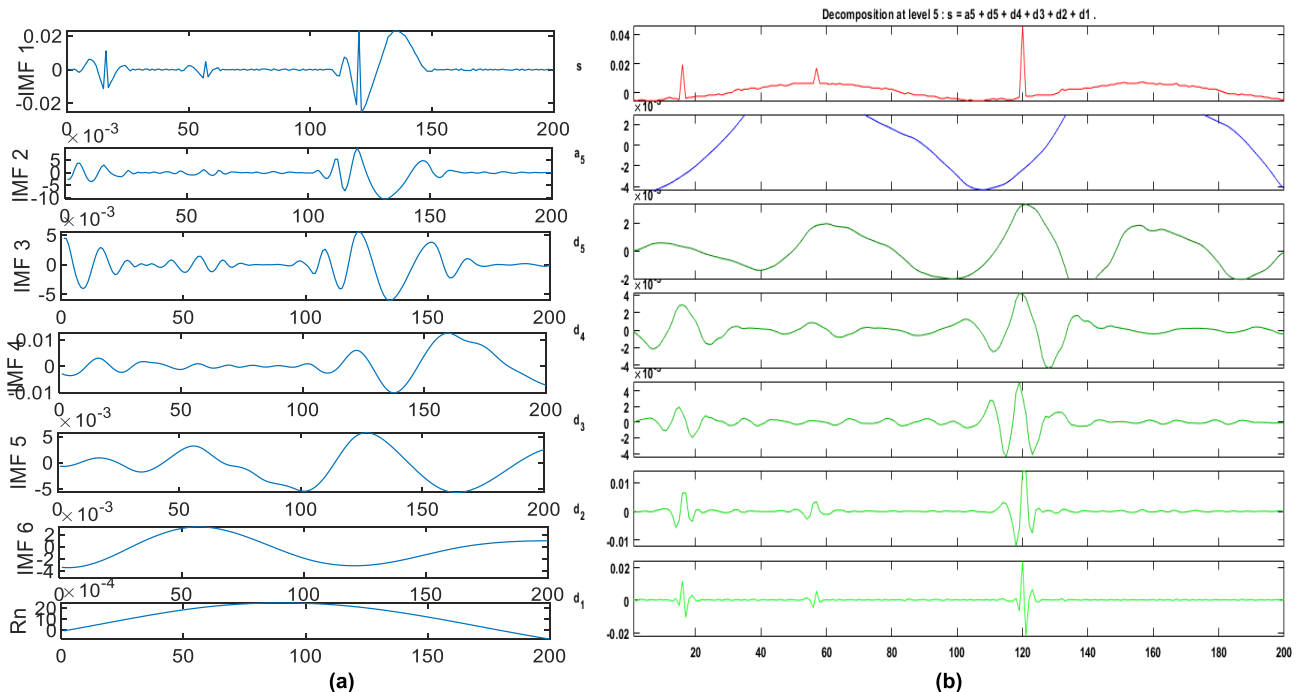


FIGURE 8. Decomposition signal using (a) EMD and (b) WD for QWHE.

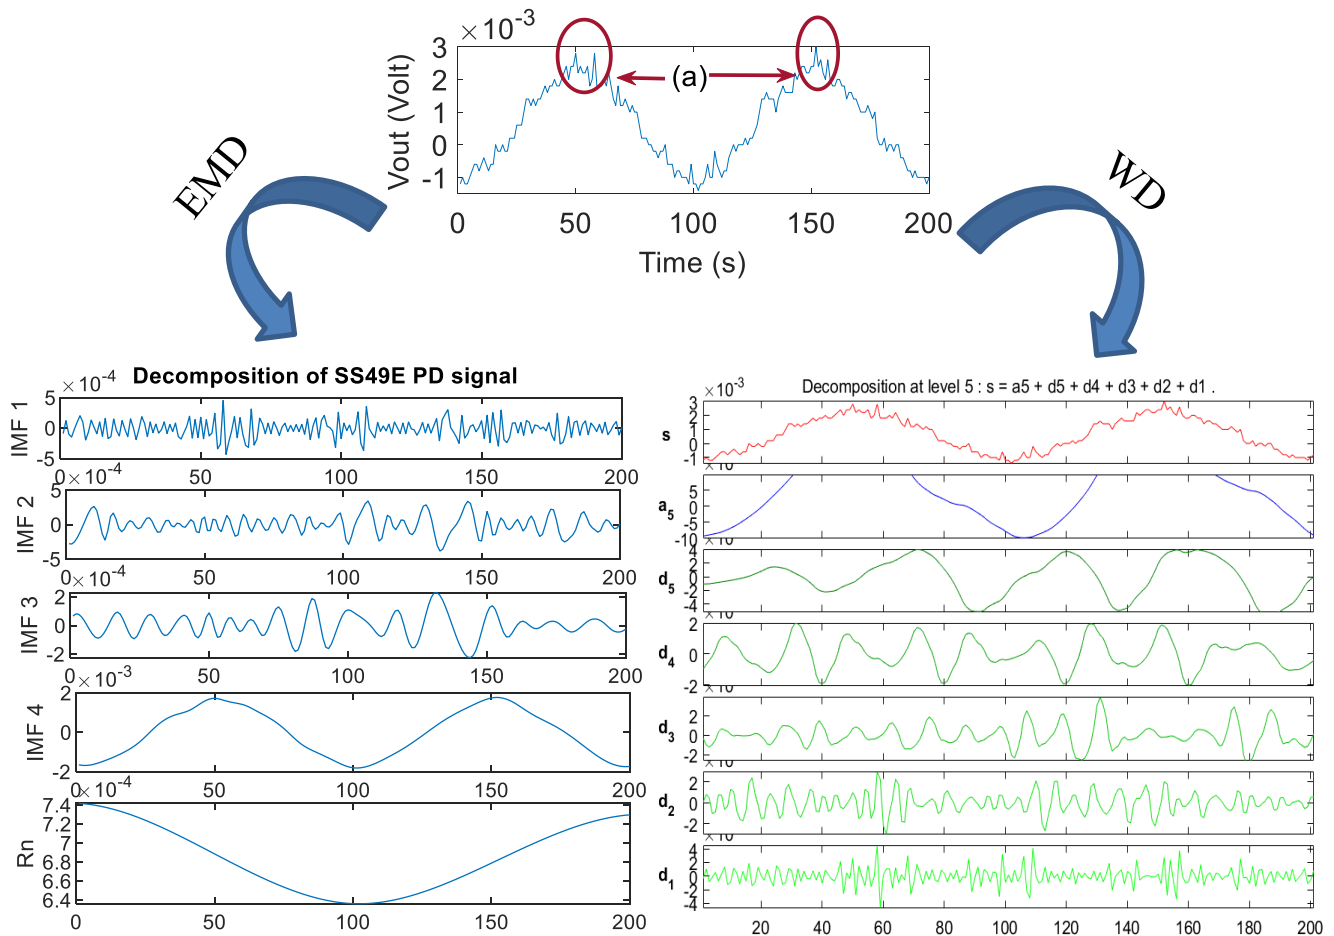


FIGURE 9. Decomposition Signal Using EMD and WD for SS49E.

analyzed. Figure 6 shows comparison of a time window captured by SS49E and QWHE sensors. The partial discharge signals observed when a 14.5 kV voltage level is applied are shown in Figure 6. The reason of selecting this voltage level is an important side of the experiment, because if higher voltage levels are applied to the insulators, hall effect sensors are burn due to exceeding electrical discharges. While the QWHE sensor detects all different types of signals that are PD and shielding detected in the experimental setup, it is seen that the SS49E sensor makes a nearly sinusoidal constant detection at a maximum value around 2.5 mV. Considering that the partial discharge signals are suddenly changing with time, it can be seen that the signals seen at points (a) and (b) are easily captured by the QWHE sensor. The most important problem here is determining the types of the (a) and (b) signals. Although the amplitudes are different in Figure 7, it can be seen that the (b) signal is repeated in the same time periods.

This shows that there is a signal originating from the shielding and measurement system in the experimental setup. However, the excessive ripple at the point of maximum value of the sinusoidal signal can be interpreted as PD signal (a) of mineral oil. In order to detect and analyze the PD signals in detail, the decomposition process was made using EMD

and WD. In Figure 8, the signal containing the PD signal in a certain period captured and read by the QWHE sensor is decomposed by both methods.

As seen in Figure 8, the PD signal for decomposed components were easily detected at about 57 ms. Signals resulting from screening (b) were observed at 18 and 120 ms by decomposing from the main component. The main advantage of using such decomposition methods is that the suddenly changing/ripples in the PD signal can be extracted. As seen in Figure 8, the PD signal for the circuit made using the QWHE sensor gives early information about the deterioration in mineral oil that has just started. The amplitude of the PD signal is 16.8 mV (nearly 95 mT), which indicates that the stress caused by the electric field in the oil has increased.

In Figure 9, EMD and WD decomposed forms of the PD signal read from the SS49E sensor are given.

Although PD signals specified at the (a) points were detected in experiments using SS49E, the characteristics of these signals do not give clear information about the electrical degradation behavior of the mineral oil. For this reason, the characteristics of the PD signals cannot be clearly seen in the decomposed signals. PD signals measured with SS49E do not provide clear information for mineral oil in

the deterioration process towards electrical discharge. The magnitude of the PD signal captured by SS49E is 2.5 mV (0.6 mT). Because the amplitude of the PD signal observed with the QWHE sensor is higher, it can be interpreted as the existence of a serious PD event in the measurement setup. Considering the properties of the signals caused by the screening, although it shows an initial characteristic for the PD, these signals cannot be characterized with a similar feature due to their repetition in the same periods. However, these signals still show that there is a PD event taking place. In the measurement with this sensor, the PD was detected, but its amplitude does not clearly reveal the dielectric behavior of the oil.

VI. CONCLUSION

The presence of partial discharges is the most significant factor that gives clues about transformer operating performance and efficiency. If these discharges take a long time, the oil insulator between the windings can be completely exposed to electrical breakdown. In this study, partial discharges occurring in transformer mineral oil were successfully monitored by using a highly sensitive QWHE sensor. The obtained experimental comparative results of the signals received from two different sensors (SS49E and QWHE) were analyzed by using different signal decomposition methods (WD, EMD). It was demonstrated that the QWHE sensor detects PD signals in a more sensitive range than the SS49E. In future studies, our aim is to create predictive models about potential transformer failures by using artificial intelligence methods using QWHE sensor-based real time PD measurements on power transformers in actual operation.

REFERENCES


- [1] F. Atalar, "Investigation of the partial discharge on pressboards immersed in mineral oil," M.S. thesis, Inst. Graduate Stud. Sci. Eng., Istanbul Univ., Istanbul, Turkey, 2018.
- [2] P. M. Mitchinson, P. L. Lewin, B. D. Strawbridge, and P. Jarman, "Tracking and surface discharge at the oil-pressboard interface," *IEEE Elect. Insul. Mag.*, vol. 26, no. 2, pp. 35–41, Mar./Apr. 2010.
- [3] F. Atalar, C. P. Uzunoğlu, S. Cekli, and M. Uğur, "Statistical analysis of induced magnetic fields on oil-impregnated insulation pressboards," *Electr. Eng.*, vol. 102, no. 4, pp. 2095–2107, Dec. 2020.
- [4] H. Zainuddin, P. L. Lewin, and P. M. Mitchinson, "Partial discharge characteristics of surface tracking on oil-impregnated pressboard under AC voltages," in *Proc. IEEE Int. Conf. Solid Dielectr. (ICSD)*, Jun. 2013, pp. 1016–1019.
- [5] J. Li, W. Si, X. Yao, and Y. Li, "Partial discharge characteristics over differently aged oil/pressboard interfaces," *IEEE Trans. Dielectr., Electr. Insul.*, vol. 16, no. 6, pp. 1640–1647, Dec. 2009.
- [6] K. Gülnihar, "Developing a novel method for partial discharge measurement and location in transformers," Ph.D. dissertation, Inst. Graduate Stud. Sci. Eng., Istanbul Univ., Istanbul, Turkey, 2017.
- [7] K. Gülnihar, S. Cekli, C. P. Uzunoğlu, and M. Uğur, "Location estimation of partial discharge-based electromagnetic source using multilateration with time difference of arrival method," *Elect. Eng.*, vol. 100, no. 2, pp. 839–847, May 2018.
- [8] Y. Shibuya, S. Matsumoto, T. Konno, and K. Umezu, "Electromagnetic waves from partial discharges in windings and their detection by patch antenna," *IEEE Trans. Dielectr., Electr. Insul.*, vol. 18, no. 6, pp. 2013–2023, Dec. 2011.
- [9] S. Ait-Amar and D. Roger, "Prospective method for partial discharge detection in large AC machines using magnetic sensors in low electric field zones," in *Proc. IET 8th Int. Conf. Comput. Electromagn. (CEM)*, 2011, pp. 1–2.
- [10] E. Önal, "Corona identification of impulse voltage and current," *Electrica*, vol. 18, no. 1, pp. 78–82, 2018.
- [11] S. İlhan, "Effects of RTV coating on the discharge characteristics of a suspension glass insulator," *Electrica*, vol. 19, no. 2, pp. 173–181, Jul. 2019.
- [12] *SS39ET/SS49E/SS59ET Series Linear Hall-Effect Sensor ICs*, document 005850-4-EN IL50 Datasheet, Honeywell, Charlotte, NC, USA, Feb. 2015.
- [13] *P2A Highly Sensitive Hall Effect Sensor, QWHE Datasheet*, Advanced Hall Sensors Manchester, U.K., Dec. 2017.
- [14] C.-W. Liang, E. Balaban, E. Ahmad, J. Sexton, and M. Missous, "A quantum well Hall effect linear isolator with wide frequency response and low gain temperature coefficient," *Sens. Actuators A, Phys.*, vol. 263, pp. 54–62, Aug. 2017.
- [15] C.-W. Liang, E. Balaban, E. Ahmad, Z. Zhang, J. Sexton, and M. Missous, "A real time high sensitivity high spatial resolution quantum well Hall effect magnetovision camera," *Sens. Actuators A, Phys.*, vol. 265, pp. 127–137, Oct. 2017.
- [16] N. Haned and M. Missous, "Nano-Tesla magnetic field magnetometry using an InGaAs-AlGaAs-GaAs 2DEG Hall sensor," *Sens. Actuators A, Phys.*, vol. 102, no. 3, pp. 216–222, Jan. 2006.
- [17] *Pressboard and Presspaper for Electrical Purposes—Part 2: Methods of Tests*, IEC Standard 60641-2, 2004.
- [18] *High Voltage Test Techniques-Partial Discharge Measurements*, IEC Standard 60270, 2015.
- [19] E. Kufel, W. S. Zaengl, and J. Kufel, *High Voltage Engineering-Fundamentals*, 2nd ed. Oxford, U.K.: Elsevier, 2000.
- [20] E. Dokur and M. Kurban, "Analysis of decomposition preprocessing methods for wind energy," in *Proc. 4th Int. Conf. Eng. Technol. Appl. Sci. (ICETAS)*, Kiev, Ukraine, 2019, pp. 309–314.
- [21] H. Liu, H. Q. Tian, and Y. F. Li, "Comparison of new hybrid FEEMD-MLP, FEEMD-ANFIS, wavelet packet-MLP and wavelet packet-ANFIS for wind speed predictions," *Energy Convers. Manage.*, vol. 89, pp. 1–11, Jan. 2015.
- [22] N. E. Huang, Z. Shen, S. R. Long, M. C. Wu, H. H. Shih, Q. Zheng, N. C. Yen, C. C. Tung, and H. H. Liu, "The empirical mode decomposition and the Hilbert spectrum for nonlinear and non-stationary time series analysis," *Proc. Roy. Soc. London A, Math., Phys. Eng. Sci.*, vol. 454, no. 1971, pp. 903–995, Mar. 1998.
- [23] Z. Zhi-hui, S. Yun-lian, and J. Yu, "Short-term load forecasting based on empirical mode decomposition and least square support vector machine," *Relay*, vol. 35, no. 8, pp. 37–40, 2007.
- [24] E. Dokur, M. Kurban, and S. Ceyhan, "Hybrid model for short term wind speed forecasting using empirical mode decomposition and artificial neural network," in *Proc. 9th Int. Conf. Electr. Electron. Eng. (ELECO)*, Bursa, Turkey, Nov. 2015, pp. 420–423.
- [25] A. Aydoğan, F. Atalar, A. E. Yılmaz, and P. Rozga, "Using the method of harmonic distortion analysis in partial discharge assessment in mineral oil in a non-uniform electric field," *Energies*, vol. 13, no. 18, p. 4830, Sep. 2020, doi: 10.3390/en13184830.



FATİH ATALAR received the bachelor's and M.Sc. degrees in electrical and electronics engineering from Istanbul University, in 2015 and 2018, respectively. Currently, he is working as a Research Assistant with the Electrical and Electronics Engineering Department, Istanbul University-Cerrahpaşa. His research interests include tracking in high voltage dielectric materials, lighting, and electromagnetic modeling with finite element method and magnetization.



EMRAH DOKUR received the B.Sc. degree in electrical and electronics engineering from Istanbul University, Turkey, in 2010, the M.Sc. degree in electrical engineering from Istanbul Technical University, Turkey, in 2013, and the Ph.D. degree in energy systems engineering from Bilecik Şeyh Edebali University. Since 2017, he has been an Assistant Professor with the Electrical Electronics Engineering Department, Bilecik Şeyh Edebali University. He is currently a Postdoctoral Researcher with the Marine and Renewable Energy Centre (MaREI), University College Cork, Ireland. His current research interests include high voltage engineering, renewable energy systems, and power system analysis. He received the Postdoctoral Fellowship Award from the Scientific and Technological Research Council of Turkey, in 2020, to conduct research in the Ireland.



Currently, he is working as a Research Scientist at private company.

ERTAN BALABAN received the B.Sc. and M.Sc. degrees from Istanbul Technical University, Turkey, in 2001 and 2005, respectively, and the Ph.D. degree in physics from Gebze Technical University, Turkey, in 2013. From 2007 to 2014, he worked at The Scientific and Technological Research Council of Turkey as a Research Engineer. From 2014 to 2021, he worked as a Research Associate and a Research Engineer with The University of Manchester and the University of Oxford.



MOHAMED MISSOUS (Senior Member, IEEE) is currently a Professor in semiconductor materials and devices with the School of Electrical and Electronic Engineering, The University of Manchester. His research interest includes centred on the growth of complex multilayer semiconductor films by the technique of molecular beam epitaxy (MBE). He has established a large MBE and the Compound Semiconductor Laboratory for materials growth, assessment equipment, compound semiconductor processing facility, and device testing. Over the years, he has concentrated with considerable success, on establishing practical approaches and techniques required to meet stringent doping and thickness control, to sub monolayer accuracy, for a variety of advanced quantum devices, from room temperature operating mid infrared quantum well infrared photodetectors, NanoTesla magnetic imaging using ultrasensitive 2DEG for nondestructive testing, and 77 GHz car radars to Terahertz materials. He is currently concentrating on the manufacturability of quantum devices, including tunnel structures. He is a fellow of the Royal Academy of Engineering, Institute of Physics, and IET. He was a recipient of the 2015 Royal Society Brian Mercer Award for Manufacturability of Tunnel Devices together with Prof. M. Kelly. He is regularly invited to give talks at international venues on mm-wave and THz technologies. His involvement in the above research topics has led to the publication over 240 papers in the open, international literature.



Turkish-German University. His research interests include tracking in polymeric dielectric materials, power systems protection, fractal modeling, and statistical evaluation of breakdown.

MUKDEN UĞUR received the M.Sc. degree from UMIST, in 1993, and the Ph.D. degree in electrical engineering from The University of Manchester, U.K., in 1997. From 1995 to 1996, he worked at National Grid Company as a Research Assistant with The University of Manchester in the subject of analyzing the breakdown process in transformer boards. Currently, he is working as a Professor with the Department of Robotics and Intelligent Systems, Institute of Science and Engineering,

...